


# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

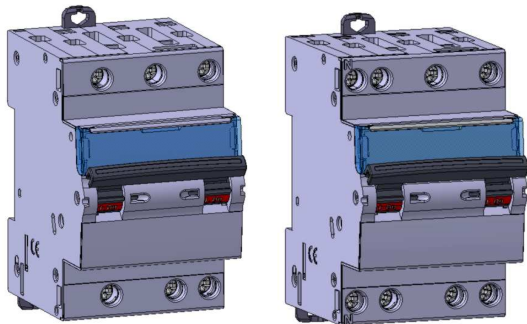

SOMMAIRE	PAGES
1. Description, utilisation .....	1
2. Gamme .....	1
3. Cotes d'encombrement .....	1
4. Mise en situation - Raccordement .....	1
5. Caractéristiques générales.....	3
6. Conformités et Agréments.....	28
7. Courbes .....	29
8. Equipements et accessoires.....	35

## 1. DESCRIPTION - USAGE

Thermal-magnetic circuit breaker (MCB) with positive contact indication for control, protection against short-circuits and overloads, and isolation of electrical circuits.

### Symbol:



### Technology:

- . Limiting device
- . Simultaneous control of all poles for closing and opening (trip-free mechanism)

## 2. RANGE

### Polarity:

- . 3P (3 protected poles)
- . 4P (4 protected poles)

### Width:

- . 3 modules (3 x 17.8 mm)

### Rated currents In:

- . 6 / 10 / 13 / 16 / 20 / 25 / 32A, C curve
- . 6 / 10 / 16 / 20 / 25 / 32A, D curve

### Magnetic tripping curves:

- . C curve (between 5 and 10 In)
- . D curve (between 10 and 14 In)


### Rated voltage and frequency:

- . 400 V ~, 50 Hz with standard tolerances
- . 415 V ~, 50 Hz with standard tolerances

### Breaking capacity:

- . Icn = 6000 A in accordance with standard EN/IEC 60898-1
- . Icu = 10 kA in accordance with standard EN/IEC 60947-2

## 3. OVERALL DIMENSIONS

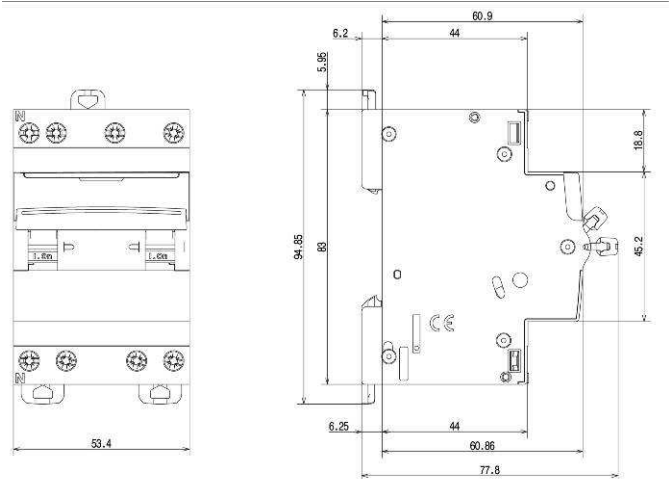


## 4. PREPARATION - CONNECTION

### Mounting:

- . On symmetrical EN 60.715 rail or DIN 35 rail

### Operating position:

- . Vertical      Horizontal      Upside down      On the side



### Power supply:

- . Either from the top or the bottom

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A


Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 4. PREPARATION - CONNECTION *(continued)*


### Module maintenance:

- . A circuit breaker may be replaced in the middle of a row supplied with busbars without disconnecting the other products.

Put the clamp in the unlocking position

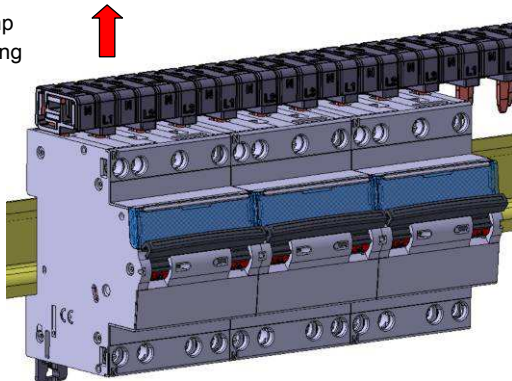


Put the clamp in the unlocking position

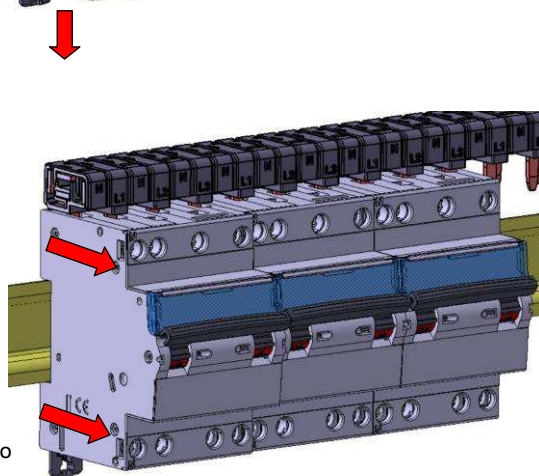

Unscrew both upper terminals completely

Pull the device forward in order to release it from the rail

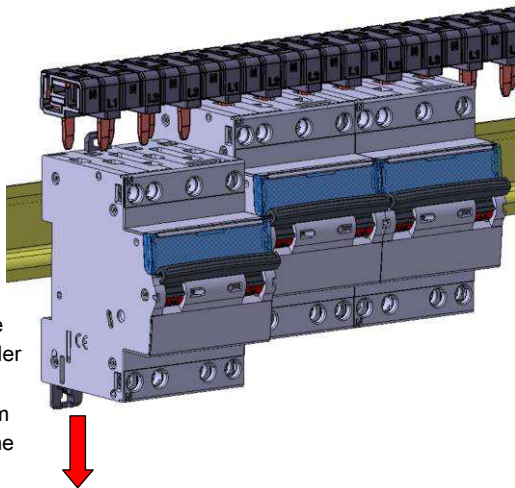

Pull the device downward in order to release it completely from the prongs of the busbar

### Connection:

- . Terminals protected against direct contact IP20, wired device
- . Cage terminals, with release and captive screws
- . Terminals fitted with shutters preventing a cable being placed under the terminal, with the terminal partly open or closed
- . Alignment and spacing of the terminals permitting connection with the other products in the range via prong supply busbars

## 4. POSITIONING - CONNECTION *(continued)*

### Connection *(continued)*:

- . Terminal depth: 14 mm at the top and 13 mm at the bottom
- . Screw head: mixed, slotted and Pozidriv no. 2
- . Tightening torques:
  - Recommended: 1.6 to 2 Nm
  - Min.: 1.2 Nm
  - Max.: 2.8 Nm

### Conductor type:

- . Copper cable or supply busbar
- . Cable cross-section

	Without ferrule	With ferrule
Rigid cable	1 x 0.75 to 16 mm <sup>2</sup> 2 x 0.75 to 6 mm <sup>2</sup>	-
Flexible cable	1 x 0.75 to 10 mm <sup>2</sup> 2 x 0.75 to 4 mm <sup>2</sup>	1 x 0.75 to 10 mm <sup>2</sup>

- . Prong busbar, alone or with a flexible wire (without ferrule) 10 mm<sup>2</sup> or a connection terminal in the same terminal.

### Recommended tools:

- . For the terminals, screwdriver with 5.5 mm blade or Pozidriv no. 2 screwdriver
- . For attaching or removing the DIN rail, screwdriver with 5.5 mm blade or Pozidriv no. 2 screwdriver

### Manual actuation of the MCB:

- . Ergonomic 2-position handle
- . "I-ON": Device closed
- . "O-OFF": Device open

### Contact status display:

- . By marking of the handle
  - "O-OFF" in white on a green background = contacts open
  - "I-ON" in white on a red background = contacts closed

### Locking:


- . Padlocks possible in the open and closed positions with padlock support (Cat. No. 4 063 03) and Ø 5 mm padlock (Cat. No. 4 063 13) or Ø 6 mm padlock (Cat. No. 0 227 97)
- . Sealing possible in the open and closed positions

### Sealing:

- . Possible in the open or closed positions

### Labelling:

- . Circuit identification by way of a label inserted in the label holder situated on the front of the product.

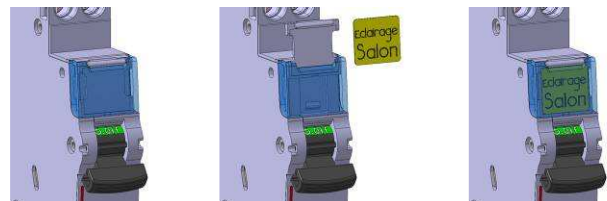

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29


## 5. GENERAL CHARACTERISTICS

### Neutral earthing system:

. IT, TT, TN


### Marking on the front side:

. By permanent ink pad printing

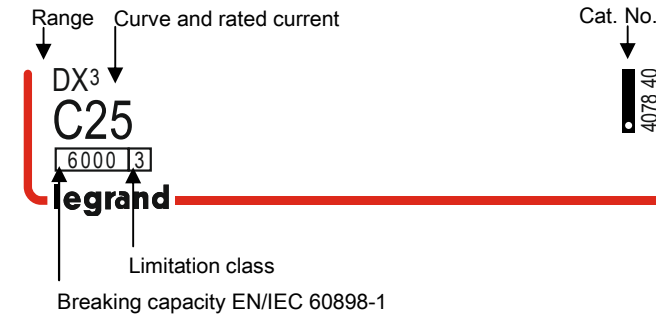

### Marking on the upper panel:

. By permanent ink pad printing

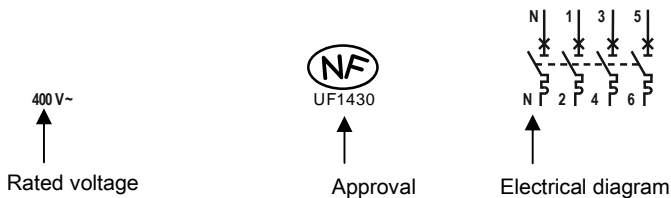

. The terminals upstream and downstream of the neutral pole are marked with an "N" moulded close to the screw heads.

### Minimum operating voltage:

. U = 12 V AC/DC

### Maximum operating voltage:

. U = 440 V

### Breaking capacity on one single pole (phase pole):

. In accordance with I<sub>IT</sub> EN60947-2 – Appendix H (double fault in IT system): 3 kA at 400 V ~ and 3 kA at 230 V ~  
. In accordance with I<sub>cn1</sub> EN60898-1: 4.5 kA at 230 V ~ and 10k A at 127 V ~

### Breaking capacity:

Standard	Breaking capacity	Voltage between poles	Breaking capacity
EN/IEC 60898-1	I <sub>cs</sub>	230 V	10 kA
	I <sub>cn</sub>		10 kA
	I <sub>cs</sub>	400 V	6 kA
	I <sub>cn</sub>		6 kA
EN/IEC 60947-2	I <sub>cu</sub>	400 V	10 kA
	I <sub>cs</sub>		50 % I <sub>cu</sub>

### Isolation distance:

. The distance between the contacts is greater than 5.5 mm with the handle in the open position.  
. The MCB is suitable for isolation in accordance with standard EN/IEC 60898-1.

## 5. GENERAL CHARACTERISTICS (continued)

### Insulation voltage:

. U<sub>i</sub> = 500 V in accordance with standard EN/IEC 60898-1

### Degree of pollution:

. 2 in accordance with standard EN/IEC 60898-1

### Dielectric strength:

. 2,000 V

### Rated impulse withstand voltage:

. U<sub>imp</sub> = 4 kV

### Degree or class of protection:

. Terminals protected against direct contact, Class of protection against solid objects and liquids (wired device): IP20 in accordance with standards IEC 529 – EN 60529 and NF 20-010  
. front panel protected against direct contact: IP40  
. Class II in relation to metallic conductive parts  
. Class of protection against mechanical impacts IK02 in accordance with standard EN 62262.

### Plastic materials:

. Polyamide and P.B.T.

### Enclosure heat and fire resistance:

. Resistance to glow wire tests at 960°C, in accordance with standard EN/IEC 60898-1  
. Classification V2, in accordance with standard UL94

### Higher heating potential:

. The heat potential is assessed at: 3.7 MJ

### Closing and opening effort via the handle:

. 5N on opening  
. 19N on closing

### Mechanical endurance:

. Compliant with standard EN/IEC 60898-1  
. Tested with 20,000 operations with no load

### Electrical endurance:

. Compliant with standard EN/IEC 60898-1  
. Tested with 10,000 operations with load (at I<sub>n</sub> x Cos φ 0.9)

### Sinusoidal vibration resistance (in accordance with IEC 68.2.6):

. Axes: x – y – z  
. Frequency: 10 to 55 Hz  
. Acceleration: 3g (1g = 9.81m.s<sup>-2</sup>)

### Resistance to tremors:

. In accordance with standard EN/IEC 60898-1

### Ambient temperatures:

. Operation: from - 25°C to + 70°C  
. Storage: from - 40°C to + 70°C

### DC operation:

. 60 V DC:  
- I<sub>cn</sub> = 4500 A in accordance with standard EN/IEC 60898-1  
- Magnetic threshold overrating:  
C curve: 5 to 15 I<sub>n</sub>  
D curve: 10 to 20 I<sub>n</sub>

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Frequency:

- . Operation at 400 Hz: yes
- . Magnetic tripping depending on the frequency
  - from 16 <sup>2/3</sup> Hz to 60 Hz: no correction
  - 400 Hz: the magnetic tripping threshold increases by 45%

### Packaged volume:

Packaging	Volume (dm <sup>3</sup> )
Per 1	<b>0.52</b>

### Average unit weight per catalogue number:

- . 3P: 0.25 kg
- . 4P: 0.30 kg

### Derating of MCBs function of the number of devices placed side by side:

When several MCBs are installed side by side and operate simultaneously, the heat dissipation of one pole is limited. This results in an increased operating temperature for the circuit breakers which may cause false tripping. Applying the following coefficients to the operating currents is recommended.

Number of MCBs side by side	Coefficient
2 - 3	<b>0.9</b>
4 - 5	<b>0.8</b>
6 - 9	<b>0.7</b>
≥ 10	<b>0.6</b>

These values are provided by recommendation IEC 60439-1 and the standards NF C 63421 and EN 60439-1.

In order to avoid having to use these coefficients there must be good ventilation and the devices must be kept apart using the spacing elements Cat. No. 4 063 07 (0.5 module).

### Derating of MCBs in the event of use with fluorescent tubes:

Electronic or ferromagnetic ballasts provide a high inrush current for a very short time. These currents are liable to cause tripping of the circuit breakers.

The maximum number of ballasts per MCB stated by the lamp and ballast manufacturers in their catalogues should be taken into account during installation.

### Impact of height:

	≤2000 m	3,000 m	4,000 m	5,000 m
Dielectric strength	<b>2,000 V</b>	<b>1,750 V</b>	<b>1,500 V</b>	<b>1,250 V</b>
Maximum operating voltage	<b>400 V</b>	<b>400 V</b>	<b>400 V</b>	<b>400 V</b>
Derating at 30°C	<b>none</b>	<b>none</b>	<b>none</b>	<b>none</b>

### Power dissipated in W per pole in In:

- . MCBs in In/Un

Calibres	6 A	10 A	13 A	16 A	20 A	25 A	32 A
P (W) Pôle	<b>1.9</b>	<b>1.5</b>	<b>2.3</b>	<b>3</b>	<b>3.2</b>	<b>3.2</b>	<b>3</b>

# DX<sup>3</sup> MCB 6000 A / 10 kA

## 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

### 5. GENERAL CHARACTERISTICS (continued)

#### Derating of MCBs depending on the ambient temperature:

. The nominal characteristics of a circuit breaker are modified depending on the ambient temperature which prevails in the cabinet or enclosure where the MCB is located.

. Reference temperature: 30°C in accordance with standard EN/IEC 60898-1.

In (A)	-25°C	-10°C	0°C	10°C	20°C	30°C	40°C	50°C	60°C	70°C
6	7	7	6.8	6.6	6.3	6	5.7	5.4	5.1	4.8
10	12	12	11.5	11	10.5	10	9.5	9	8.5	8
13	15.6	15.6	15	14.3	13.7	13	12.3	11.7	11	10.4
16	19.2	19.2	18.4	17.6	16.8	16	15.2	14.4	13.6	12.8
20	24	24	23	22	21	20	19	18.7	18.2	17.5
25	30	30	28.7	27.5	26.2	25	23.7	22.6	21.5	20.5
32	38.4	38.4	36.8	35.2	33.6	32	30.4	29	27.5	26

#### Association and coordination of a MCB with a protective device located upstream:

This association allows a device's breaking capacity to be increased by combining it with another protective device placed upstream.

This combination makes it possible to use a downstream device with a breaking capacity which is lower than the maximum prospective short-circuit current at its installation point.

#### Association and coordination with upstream fuses:

. Three-phase network (+N) 400 V/415 V in accordance with standard EN/IEC 60947-2

. TT neutral earthing or TNS system

Downstream MCB		Upstream fuse									
		gG and aM types									
		≤20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX <sup>3</sup> 6000 / 10 kA C et D curves	≤ 13 A	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	16 A	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	20 A	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	25 A	-	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	32 A	-	-	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA

#### Association and coordination with upstream MCBs:

. Three-phase network (+N) 400 V/415 V in accordance with standard EN/IEC 60947-2

. TT neutral earthing or TNS system

Downstream MCB		Upstream MCB		
		DX <sup>3</sup> 10000 / 16 kA B, C and D curves		
		≤ 25 A	32 A	40 à 125 A
DX <sup>3</sup> 6000 / 10 kA C curve	≤ 20 A	16 kA	16 kA	16 kA
	25 A	-	16 kA	16 kA
	32 A	-	-	16 kA

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. CARACTERISTIQUES GENERALES (suite)

### Association et coordination avec des disjoncteurs modulaires en amont :

- . En réseau triphasé (+N) 400 V / 415 V selon la norme IEC 60947-2
- . Régime de Neutre TT ou TNS

Downstream MCB		Upstream MCB				
		DX <sup>3</sup> 10000 / 16 kA B and C curves				
		≤ 25 A	32 A	40 A	53 A	63 à 125 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10 A	<b>16 kA</b>	<b>16 kA</b>	<b>16 kA</b>	<b>16 kA</b>	<b>16 kA</b>
	16 A	-	<b>16 kA</b>	<b>16 kA</b>	<b>16 kA</b>	<b>16 kA</b>
	20 A	-	-	<b>16 kA</b>	<b>16 kA</b>	<b>16 kA</b>
	25 A	-	-	-	<b>16 kA</b>	<b>16 kA</b>
	32 A	-	-	-	-	<b>16 kA</b>

Downstream MCB		Upstream MCB		
		DX <sup>3</sup> 10000 / 16 kA D curve		
		≤ 25 A	32 A	40 à 125 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 20 A	<b>16 kA</b>	<b>16 kA</b>	<b>16 kA</b>
	25 A	-	<b>16 kA</b>	<b>16 kA</b>
	32 A	-	-	<b>16 kA</b>

Downstream MCB		Upstream MCB								
		DX <sup>3</sup> 25 kA B , C and D curves			DX <sup>3</sup> 36 kA C curve			DX <sup>3</sup> 50 kA B , C and D curves		
		≤ 25 A	32 A	40 à 125 A	≤ 25 A	32 A	40 à 80 A	≤ 25 A	32 A	40 à 63 A
DX <sup>3</sup> 6000 / 10 kA C curve	≤ 20 A	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>36 kA</b>	<b>36 kA</b>	<b>36 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	25 A	-	<b>25 kA</b>	<b>25 kA</b>	-	<b>36 kA</b>	<b>36 kA</b>	-	<b>50 kA</b>	<b>50 kA</b>
	32 A	-	-	<b>25 kA</b>	-	-	<b>36 kA</b>	-	-	<b>50 kA</b>

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Association and coordination with upstream MCBs:

- . Three-phase network (+N) 400 V/415 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream MCB				
		DX <sup>3</sup> 25 kA B, C and D curves				
Downstream MCB		≤ 25 A	32 A	40 A	50 A	63 à 125 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	16 A	-	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	20 A	-	-	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	25 A	-	-	-	<b>25 kA</b>	<b>25 kA</b>
	32 A	-	-	-	-	<b>25 kA</b>

Downstream MCB		Upstream MCB				
		DX <sup>3</sup> 36 kA C curve				
Downstream MCB		≤ 25 A	32 A	40 A	50 A	63 à 80 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>36 kA</b>	<b>36 kA</b>	<b>36 kA</b>	<b>36 kA</b>	<b>36 kA</b>
	16 A	-	<b>36 kA</b>	<b>36 kA</b>	<b>36 kA</b>	<b>36 kA</b>
	20 A	-	-	<b>36 kA</b>	<b>36 kA</b>	<b>36 kA</b>
	25 A	-	-	-	<b>36 kA</b>	<b>36 kA</b>
	32 A	-	-	-	-	<b>36 kA</b>

Downstream MCB		Upstream MCB				
		DX <sup>3</sup> 50 kA B and C curves				
Downstream MCB		≤ 25 A	32 A	40 A	50 A	63 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	16 A	-	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	20 A	-	-	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	25 A	-	-	-	<b>50 kA</b>	<b>50 kA</b>
	32 A	-	-	-	-	<b>50 kA</b>

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Association and coordination with upstream MCBs:

- . Three-phase network (+N) 400 V/415 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream MCB		
		DX <sup>3</sup> 50 kA D curve		
		≤ 25 A	32 A	40 à 63 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	16 A	-	<b>50 kA</b>	<b>50 kA</b>
	20 A	-	-	<b>50 kA</b>

### Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs):

- . Three-phase network (+N) 400 V/415 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream MCCB											
		DPX <sup>3</sup> 160 16 kA			DPX <sup>3</sup> 160 25 kA			DPX <sup>3</sup> 160 36 kA			DPX <sup>3</sup> 160 50 kA		
		16 A	25 A	40 à 160 A	16A	25A	40 à 160 A	16A	25A	40 à 160 A	16A	25A	40 à 160 A
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 13 A	<b>16 kA</b>	<b>16 kA</b>	<b>16 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	16 A	-	<b>16 kA</b>	<b>16 kA</b>	-	<b>25 kA</b>	<b>25 kA</b>	-	<b>25 kA</b>	<b>25 kA</b>	-	<b>25 kA</b>	<b>25 kA</b>
	20 A	-	<b>16 kA</b>	<b>16 kA</b>	-	<b>25 kA</b>	<b>25 kA</b>	-	<b>25 kA</b>	<b>25 kA</b>	-	<b>25 kA</b>	<b>25 kA</b>
	25 A	-	-	<b>16 kA</b>	-	-	<b>25 kA</b>	-	-	<b>25 kA</b>	-	-	<b>25 kA</b>
	32 A	-	-	<b>16 kA</b>	-	-	<b>25 kA</b>	-	-	<b>25 kA</b>	-	-	<b>25 kA</b>

Downstream MCB		Upstream MCCB			
		DPX <sup>3</sup> 250 25 kA		DPX <sup>3</sup> 250 36 kA	
		25 à 250 A		25 à 250 A	
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 32 A	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>



# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs):

- . Three-phase network (+N) 400 V/415 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream MCCB				
		DPX / DPX-H / DPX-L 250	DPX / DPX-H 630	DPX / DPX-H 1250	DPX / DPX-H 1600	
		25 A	40 à 250 A	250 à 630 A	500 à 1250 A	630 à 1600 A
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 20 A	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	25 A	-	<b>25 kA</b>	<b>25 kA</b>	<b>20 kA</b>	<b>20 kA</b>
	32 A	-	<b>25 kA</b>	<b>25 kA</b>	<b>15 kA</b>	<b>15 kA</b>

Downstream MCB		Upstream MCCB	
		DPX 250 ER AB	DPX 400 AB
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 32 A	<b>25 kA</b>	<b>25 kA</b>

### Association and coordination with upstream fuses:

- . Three-phase network (+N) 230 V/240 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream fuse									
		gG and aM types									
		≤20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 13 A	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>40 kA</b>
	16 A	-	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>40 kA</b>
	20 A	-	-	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>40 kA</b>
	25 A	-	-	-	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>40 kA</b>
	32 A	-	-	-	-	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>100 kA</b>	<b>40 kA</b>

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Association and coordination with upstream MCBs:

- . Three-phase network (+N) 230 V/240 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream MCB		
		DX <sup>3</sup> 10000 / 16 kA B, C and D curves		
		≤ 25 A	32 A	40 à 125 A
DX <sup>3</sup> 6000 / 10 kA C curve	≤ 20 A	<b>32 kA</b>	<b>32 kA</b>	<b>25 kA</b>
	25 A	-	<b>32 kA</b>	<b>25 kA</b>
	32 A	-	-	<b>25 kA</b>

Downstream MCB		Upstream MCB				
		DX <sup>3</sup> 10000 / 16 kA B and C curves				
		≤ 25 A	32 A	40 A	50 A	63 à 125 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>32 kA</b>	<b>32 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	16 A	-	<b>32 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	20 A	-	-	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	25 A	-	-	-	<b>25 kA</b>	<b>25 kA</b>
	32 A	-	-	-	-	<b>25 kA</b>

Downstream MCB		Upstream MCB		
		DX <sup>3</sup> 10000 / 16 kA D curve		
		≤ 25 A	32 A	40 à 125 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 20 A	<b>32 kA</b>	<b>32 kA</b>	<b>25 kA</b>
	25 A	-	<b>32 kA</b>	<b>25 kA</b>
	32 A	-	-	<b>25 kA</b>

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Association and coordination with upstream MCBs:

- . Three-phase network (+N) 230 V/240 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream MCB								
		DX <sup>3</sup> 25 kA B, C and D curves			DX <sup>3</sup> 36kA C curve			DX <sup>3</sup> 50 kA B, C and D curves		
		≤ 25 A	32 A	40 à 125 A	≤ 25 A	32 A	40 à 80 A	≤ 25 A	32 A	40 à 63 A
DX <sup>3</sup> 6000 / 10 kA C curve	≤ 20 A	<b>50 kA</b>	<b>50 kA</b>	<b>25 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	25 A	-	<b>50 kA</b>	<b>25 kA</b>	-	<b>50 kA</b>	<b>50 kA</b>	-	<b>50 kA</b>	<b>50 kA</b>
	32 A	-	-	<b>25 kA</b>	-	-	<b>50 kA</b>	-	-	<b>50 kA</b>

Downstream MCB		Upstream MCB				
		DX <sup>3</sup> 25 kA B et C curves				
		≤ 25 A	32 A	40 A	50 A	63 à 125 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>50 kA</b>	<b>50 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	16 A	-	<b>50 kA</b>	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	20 A	-	-	<b>25 kA</b>	<b>25 kA</b>	<b>25 kA</b>
	25 A	-	-	-	<b>25 kA</b>	<b>25 kA</b>
	32 A	-	-	-	-	<b>25 kA</b>

Downstream MCB		Upstream MCB		
		DX <sup>3</sup> 25 kA D curve		
		≤ 25 A	32 A	40 à 63 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>50 kA</b>	<b>50 kA</b>	<b>25 kA</b>
	16 A	-	<b>50 kA</b>	<b>25 kA</b>
	20 A	-	-	<b>25 kA</b>

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Association and coordination with upstream MCBs:

- . Three-phase network (+N) 230 V/240 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream MCB				
		DX <sup>3</sup> 36 kA C curve				
		≤ 25 A	32 A	40 A	50 A	63 à 80 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	16 A	-	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	20 A	-	-	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	25 A	-	-	-	<b>50 kA</b>	<b>50 kA</b>
	32 A	-	-	-	-	<b>50 kA</b>

Downstream MCB		Upstream MCB				
		DX <sup>3</sup> 50 kA B et C curves				
		≤ 25 A	32 A	40 A	50 A	63 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	16 A	-	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	20 A	-	-	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	25 A	-	-	-	<b>50 kA</b>	<b>50 kA</b>
	32 A	-	-	-	-	<b>50 kA</b>

Downstream MCB		Upstream MCB		
		DX <sup>3</sup> 50 kA D curve		
		≤ 25 A	32 A	40 à 63 A
DX <sup>3</sup> 6000 / 10 kA D curve	≤ 10A	<b>50 kA</b>	<b>50 kA</b>	<b>25 kA</b>
	16 A	-	<b>50 kA</b>	<b>25 kA</b>
	20 A	-	-	<b>25 kA</b>

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs):

- . Three-phase network (+N) 230 V/240 V in accordance with standard EN/IEC 60947-2
- . TT neutral earthing or TNS system

Downstream MCB		Upstream MCCB											
		DPX <sup>3</sup> 160 16 kA			DPX <sup>3</sup> 160 25 kA			DPX <sup>3</sup> 160 36 kA			DPX <sup>3</sup> 160 50 kA		
Downstream MCB		16 A	25 A	40 à 160 A	16 A	25 A	40 à 160 A	16 A	25 A	40 à 160 A	16 A	25 A	40 à 160 A
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 13 A	<b>28 kA</b>	<b>28 kA</b>	<b>28 kA</b>	<b>40 kA</b>	<b>40 kA</b>	<b>40 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	16 A	-	<b>28 kA</b>	<b>28 kA</b>	-	<b>40 kA</b>	<b>40 kA</b>	-	<b>50 kA</b>	<b>50 kA</b>	-	<b>50 kA</b>	<b>50 kA</b>
	20 A	-	<b>28 kA</b>	<b>28 kA</b>	-	<b>40 kA</b>	<b>40 kA</b>	-	<b>50 kA</b>	<b>50 kA</b>	-	<b>50 kA</b>	<b>50 kA</b>
	25 A	-	-	<b>28 kA</b>	-	-	<b>40 kA</b>	-	-	<b>50 kA</b>	-	-	<b>50 kA</b>
	32 A	-	-	<b>28 kA</b>	-	-	<b>40 kA</b>	-	-	<b>50 kA</b>	-	-	<b>50 kA</b>

Downstream MCB		Upstream MCCB			
		DPX <sup>3</sup> 250 - 25 kA	DPX <sup>3</sup> 250 - 36 kA	DPX <sup>3</sup> 250 - 50 kA	DPX <sup>3</sup> 250 - 70 kA
Downstream MCB		≤ 250 A	≤ 250 A	≤ 250 A	≤ 250 A
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 32 A	<b>40 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>

Downstream MCB		Upstream MCCB				
		DPX / DPX-H / DPX-L 250		DPX / DPX-H 630	DPX / DPX-H 1250	DPX / DPX-H 1600
Downstream MCB		25A	40 à 250 A	≤ 630 A	≤ 1250 A	≤ 1600 A
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 20 A	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	25 A	-	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>
	32 A	-	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>	<b>50 kA</b>

Downstream MCB		Upstream MCCB	
		DPX 250 ER AB	DPX 400 AB
Downstream MCB		DPX 250 ER AB	DPX 400 AB
DX <sup>3</sup> 6000 / 10 kA C and D curves	≤ 32 A	<b>50 kA</b>	<b>50 kA</b>

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Selectivity between two levels of protection

- . The downstream MCB must always have a magnetic threshold and a rated current lower than those of the upstream protection.
- . Selectivity or Discrimination is said to be total (T) if there is discrimination up to the value of breaking capacity (in accordance with standard EN/IEC 60947-2) of the downstream MCB.

### Discrimination with upstream fuses:

- . Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream fuse							
		gG type							
		32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	1300	1900	2500	4000	4600	T	T	T
	10 A	-	1600	2200	3200	3600	7000	T	T
	13 A	-	1400	1800	2600	3000	5600	8000	T
	16 A	-	1400	1800	2600	3000	5600	8000	T
	20 A	-	1200	1500	2200	2500	4600	6300	T
	25 A	-	-	1300	2000	2200	4100	5500	9000
	32 A	-	-	1200	1700	1900	3500	4500	8000

Downstream MCB		Upstream fuse							
		gG type							
		32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	1200	1600	2200	4000	4200	8000	T	T
	10 A	-	1600	2200	3200	3600	7000	T	T
	16 A	-	1400	1800	2600	3000	5600	8000	T
	20 A	-	1200	1500	2200	2500	4600	6300	T
	25 A	-	-	1200	1800	2100	3700	5000	6000
	32 A	-	-	-	1500	1800	3000	4000	5000

Downstream MCB		Upstream fuse								
		aM type								
		25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	1000	1600	2100	3200	6200	T	T	T	T
	10 A	-	1100	1700	2500	5000	7800	T	T	T
	13 A	-	1000	1400	2100	4000	6000	9000	T	T
	16 A	-	1000	1400	2100	4000	6000	9000	T	T
	20 A	-	-	1300	1800	3400	5100	7000	T	T
	25 A	-	-	1100	1600	3000	4500	6000	9300	T
	32 A	-	-	-	1300	2400	3800	5000	7700	9000

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream fuses:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream fuse								
		aM type								
		25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	<b>9000</b>	<b>1400</b>	<b>2000</b>	<b>2700</b>	<b>5500</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	10 A	-	<b>1100</b>	<b>1700</b>	<b>2500</b>	<b>5000</b>	<b>7800</b>	<b>T</b>	<b>T</b>	<b>T</b>
	16 A	-	<b>1000</b>	<b>1400</b>	<b>2100</b>	<b>4000</b>	<b>6000</b>	<b>9000</b>	<b>T</b>	<b>T</b>
	20 A	-	-	<b>1300</b>	<b>1800</b>	<b>3400</b>	<b>5100</b>	<b>7000</b>	<b>T</b>	<b>T</b>
	25 A	-	-	<b>1000</b>	<b>1500</b>	<b>2700</b>	<b>4000</b>	<b>5500</b>	<b>9000</b>	<b>T</b>
	32 A	-	-	-	<b>1100</b>	<b>2100</b>	<b>3500</b>	<b>4700</b>	<b>7500</b>	<b>T</b>

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCB											
		DX <sup>3</sup> 4500 / 6 kA - DX <sup>3</sup> 6000 / 10 kA - DX <sup>3</sup> 10000 / 16 kA B curve											
		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	-	<b>52</b>	<b>64</b>	<b>80</b>	<b>100</b>	<b>128</b>	<b>160</b>	<b>200</b>	<b>252</b>	<b>4000</b>	<b>T</b>	<b>T</b>
	10 A	-	-	-	<b>80</b>	<b>100</b>	<b>128</b>	<b>160</b>	<b>200</b>	<b>252</b>	<b>3000</b>	<b>5000</b>	<b>T</b>
	13 A	-	-	-	-	<b>100</b>	<b>128</b>	<b>160</b>	<b>200</b>	<b>252</b>	<b>2500</b>	<b>4000</b>	<b>6000</b>
	16 A	-	-	-	-	-	<b>128</b>	<b>160</b>	<b>200</b>	<b>252</b>	<b>2000</b>	<b>3600</b>	<b>5500</b>
	20 A	-	-	-	-	-	-	<b>160</b>	<b>200</b>	<b>252</b>	<b>1600</b>	<b>3000</b>	<b>4000</b>
	25 A	-	-	-	-	-	-	-	<b>200</b>	<b>252</b>	<b>1300</b>	<b>2400</b>	<b>3300</b>
	32 A	-	-	-	-	-	-	-	-	<b>252</b>	<b>1000</b>	<b>1800</b>	<b>2700</b>

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

		Upstream MCB											
		DX <sup>3</sup> 4500 / 6 kA - DX <sup>3</sup> 6000 / 10 kA - DX <sup>3</sup> 10000 / 16 kA B curve											
Downstream MCB		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	-	-	-	-	<b>100</b>	<b>128</b>	<b>160</b>	<b>200</b>	<b>252</b>	<b>4000</b>	<b>T</b>	<b>T</b>
	10 A	-	-	-	-	-	-	<b>160</b>	<b>200</b>	<b>252</b>	<b>3000</b>	<b>5000</b>	<b>T</b>
	16 A	-	-	-	-	-	-	-	<b>200</b>	<b>252</b>	<b>2000</b>	<b>3600</b>	<b>5500</b>
	20 A	-	-	-	-	-	-	-	-	<b>252</b>	<b>1600</b>	<b>3000</b>	<b>4000</b>
	25 A	-	-	-	-	-	-	-	-	-	<b>1300</b>	<b>2400</b>	<b>3300</b>
	32 A	-	-	-	-	-	-	-	-	-	-	<b>1800</b>	<b>2700</b>

		Upstream MCB											
		DX <sup>3</sup> 3000 - DX <sup>3</sup> 4500 / 6 kA - DX <sup>3</sup> 6000 / 10 kA - DX <sup>3</sup> 10000 / 16 kA C curve											
Downstream MCB		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	<b>75</b>	<b>98</b>	<b>120</b>	<b>150</b>	<b>187</b>	<b>240</b>	<b>300</b>	<b>375</b>	<b>472</b>	<b>4000*</b>	<b>T*</b>	<b>T*</b>
	10 A	-	<b>98</b>	<b>120</b>	<b>150</b>	<b>187</b>	<b>240</b>	<b>300</b>	<b>375</b>	<b>472</b>	<b>3000</b>	<b>5000*</b>	<b>T*</b>
	13 A	-	-	<b>120</b>	<b>150</b>	<b>187</b>	<b>240</b>	<b>300</b>	<b>375</b>	<b>472</b>	<b>2500</b>	<b>4000*</b>	<b>6000*</b>
	16 A	-	-	-	<b>150</b>	<b>187</b>	<b>240</b>	<b>300</b>	<b>375</b>	<b>472</b>	<b>2000</b>	<b>3600*</b>	<b>5500*</b>
	20 A	-	-	-	-	<b>187</b>	<b>240</b>	<b>300</b>	<b>375</b>	<b>472</b>	<b>1600</b>	<b>3000</b>	<b>4000*</b>
	25 A	-	-	-	-	-	<b>240</b>	<b>300</b>	<b>375</b>	<b>472</b>	<b>1300</b>	<b>2400</b>	<b>3300*</b>
	32 A	-	-	-	-	-	-	<b>300</b>	<b>375</b>	<b>472</b>	<b>1000</b>	<b>1800</b>	<b>2700</b>

. T = Total discrimination

. \* : If the discrimination value stated in the table is greater than the breaking capacity of the upstream MCB then the breaking capacity of the upstream device must be taken as the discrimination value (the discrimination value may not exceed the breaking capacity of the upstream device).



# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

		Upstream MCB											
		DX <sup>3</sup> 3000 - DX <sup>3</sup> 4500 / 6 kA - DX <sup>3</sup> 6000 / 10 kA - DX <sup>3</sup> 10000 / 16 kA C curve											
Downstream MCB		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	-	-	120	150	187	240	300	375	472	4000*	T*	T*
	10 A	-	-	-	150	187	240	300	375	472	3000	5000*	T*
	16 A	-	-	-	-	-	240	300	375	472	2000	3600*	5500*
	20 A	-	-	-	-	-	-	300	375	472	1600	3000	4000*
	25 A	-	-	-	-	-	-	-	375	472	1300	2400	3300*
	32 A	-	-	-	-	-	-	-	-	472	1000	1800	2700

		Upstream MCB											
		DX <sup>3</sup> 4500 / 4,5 kA - DX <sup>3</sup> 6000 / 10 kA - DX <sup>3</sup> 10000/16kA D curve											
Downstream MCB		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	120	156	192	240	300	384	480	600	756	4000	T	T
	10 A	-	-	192	240	300	384	480	600	756	3000	5000	T
	13 A	-	-	-	240	300	384	480	600	756	2500	4000	6000
	16 A	-	-	-	240	300	384	480	600	756	2000	3600	5500
	20 A	-	-	-	-	300	384	480	600	756	1600	3000	4000
	25 A	-	-	-	-	-	384	480	600	756	1300	2400	3300
	32 A	-	-	-	-	-	-	480	600	756	1100	1450	2700

. T = Total discrimination

. \*: If the discrimination value stated in the table is greater than the breaking capacity of the upstream MCB then the breaking capacity of the upstream device must be taken as the discrimination value (the discrimination value may not exceed the breaking capacity of the upstream device).

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

		Upstream MCB											
		DX <sup>3</sup> 4500 / 4,5 kA - DX <sup>3</sup> 6000 / 10 kA - DX <sup>3</sup> 10000 / 16 kA D curve											
Downstream MCB		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	-	<b>156</b>	<b>192</b>	<b>240</b>	<b>300</b>	<b>384</b>	<b>480</b>	<b>600</b>	<b>756</b>	<b>4000</b>	T	T
	10 A	-	-	<b>192</b>	<b>240</b>	<b>300</b>	<b>384</b>	<b>480</b>	<b>600</b>	<b>756</b>	<b>3000</b>	<b>5000</b>	T
	16 A	-	-	-	<b>240</b>	<b>300</b>	<b>384</b>	<b>480</b>	<b>600</b>	<b>756</b>	<b>2000</b>	<b>3600</b>	<b>5500</b>
	20 A	-	-	-	-	<b>300</b>	<b>384</b>	<b>480</b>	<b>600</b>	<b>756</b>	<b>1600</b>	<b>3000</b>	<b>4000</b>
	25 A	-	-	-	-	-	<b>384</b>	<b>480</b>	<b>600</b>	<b>756</b>	<b>1300</b>	<b>2400</b>	<b>3300</b>
	32 A	-	-	-	-	-	-	<b>480</b>	<b>600</b>	<b>756</b>	<b>1100</b>	<b>1450</b>	<b>2700</b>

		Upstream MCB											
		DX <sup>3</sup> 25 kA B curve											
Downstream MCB		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	-	<b>64</b>	<b>80</b>	<b>100</b>	<b>700</b>	<b>1200</b>	<b>1500</b>	<b>3000</b>	<b>4000</b>	T	T	
	10 A	-	-	<b>80</b>	<b>100</b>	<b>500</b>	<b>700</b>	<b>1000</b>	<b>1800</b>	<b>3000</b>	<b>5000</b>	T	
	13 A	-	-	-	<b>100</b>	<b>400</b>	<b>600</b>	<b>1000</b>	<b>1500</b>	<b>2500</b>	<b>4000</b>	<b>6000</b>	
	16 A	-	-	-	-	<b>300</b>	<b>500</b>	<b>700</b>	<b>1300</b>	<b>2000</b>	<b>3600</b>	<b>5500</b>	
	20 A	-	-	-	-	-	<b>400</b>	<b>500</b>	<b>1000</b>	<b>1600</b>	<b>3000</b>	<b>4000</b>	
	25 A	-	-	-	-	-	-	<b>500</b>	<b>800</b>	<b>1300</b>	<b>2400</b>	<b>3300</b>	
	32 A	-	-	-	-	-	-	<b>500</b>	<b>600</b>	<b>1000</b>	<b>1800</b>	<b>2700</b>	

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

		Upstream MCB										
		DX <sup>3</sup> 25 kA B curve										
Downstream MCB		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	-	-	-	<b>100</b>	<b>700</b>	<b>1200</b>	<b>1500</b>	<b>3000</b>	<b>4000</b>	T	T
	10 A	-	-	-	-	<b>500</b>	<b>700</b>	<b>1000</b>	<b>1800</b>	<b>3000</b>	<b>5000</b>	T
	16 A	-	-	-	-	-	-	<b>1200</b>	<b>1300</b>	<b>2000</b>	<b>3600</b>	<b>5500</b>
	20 A	-	-	-	-	-	-	-	<b>1000</b>	<b>1600</b>	<b>3000</b>	<b>4000</b>
	25 A	-	-	-	-	-	-	-	-	<b>1300</b>	<b>2400</b>	<b>3300</b>
	32 A	-	-	-	-	-	-	-	-	-	<b>1800</b>	<b>2700</b>

		Upstream MCB										
		DX <sup>3</sup> 25 kA C curve										
Downstream MCB		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	<b>75</b>	<b>120</b>	<b>150</b>	<b>187</b>	<b>700</b>	<b>1200</b>	<b>1500</b>	<b>3000</b>	<b>4000</b>	T	T
	10 A	-	<b>120</b>	<b>150</b>	<b>187</b>	<b>500</b>	<b>700</b>	<b>1000</b>	<b>1800</b>	<b>3000</b>	<b>5000</b>	T
	13 A	-	<b>120</b>	<b>150</b>	<b>187</b>	<b>400</b>	<b>600</b>	<b>1000</b>	<b>1500</b>	<b>2500</b>	<b>4000</b>	<b>6000</b>
	16 A	-	-	<b>150</b>	<b>187</b>	<b>300</b>	<b>500</b>	<b>700</b>	<b>1300</b>	<b>2000</b>	<b>3600</b>	<b>5500</b>
	20 A	-	-	-	<b>187</b>	<b>300</b>	<b>400</b>	<b>500</b>	<b>1000</b>	<b>1600</b>	<b>3000</b>	<b>4000</b>
	25 A	-	-	-	-	<b>240</b>	<b>400</b>	<b>500</b>	<b>800</b>	<b>1300</b>	<b>2400</b>	<b>3300</b>
	32 A	-	-	-	-	-	<b>300</b>	<b>500</b>	<b>600</b>	<b>1000</b>	<b>1800</b>	<b>2700</b>

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

		Upstream MCB										
		DX <sup>3</sup> 25 kA C curve										
Downstream MCB		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	-	120	150	187	700	1200	1500	3000	4000	T	T
	10 A	-	-	150	187	500	700	1000	1800	3000	5000	T
	16 A	-	-	-	-	300	500	700	1300	2000	3600	5500
	20 A	-	-	-	-	-	400	500	1000	1600	3000	4000
	25 A	-	-	-	-	-	-	500	800	1300	2400	3300
	32 A	-	-	-	-	-	-	-	600	1000	1800	2700

		Upstream MCB										
		DX <sup>3</sup> 25 kA D curve										
Downstream MCB		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX <sup>3</sup> 6000 / 10 kA C and D curves	6 A	120	192	240	500	700	1200	1500	3000	4000	T	T
	10 A	-	192	240	300	500	700	1000	1800	3000	5000	T
	13 A	-	-	240	300	400	600	1000	1500	2500	4000	6000
	16 A	-	-	240	300	384	500	700	1300	2000	3600	5500
	20 A	-	-	-	300	384	480	600	1000	1600	3000	4000
	25 A	-	-	-	-	384	480	600	800	1300	2400	3300
	32 A	-	-	-	-	-	480	600	756	1100	1450	2700

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCB								
		DX <sup>3</sup> 36 kA / DX <sup>3</sup> 50 kA C curve								
Downstream MCB		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	75	120	170	500	700	1200	1500	3000	4000
	10 A	-	120	150	210	500	700	1000	1800	3000
	13 A	-	120	150	200	400	600	1000	1500	2500
	16 A	-	-	150	187	300	500	700	1300	2000
	20 A	-	-	-	187	300	400	500	1000	1600
	25 A	-	-	-	-	240	400	500	800	1300
	32 A	-	-	-	-	-	300	500	600	1000

Downstream MCB		Upstream MCB								
		DX <sup>3</sup> 36 kA / DX <sup>3</sup> 50 kA C curve								
Downstream MCB		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	-	120	170	500	700	1200	1500	3000	4000
	10 A	-	-	150	210	500	700	1000	1800	3000
	16 A	-	-	-	-	300	500	700	1300	2000
	20 A	-	-	-	-	-	400	500	1000	1600
	25 A	-	-	-	-	-	-	500	800	1300
	32 A	-	-	-	-	-	-	-	600	1000

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCB							
		DX <sup>3</sup> 50 kA B curve							
		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	-	<b>64</b>	<b>170</b>	<b>500</b>	<b>700</b>	<b>1200</b>	<b>1500</b>	<b>3000</b>
	10 A	-	-	<b>150</b>	<b>210</b>	<b>500</b>	<b>700</b>	<b>1000</b>	<b>1800</b>
	13 A	-	-	-	<b>200</b>	<b>400</b>	<b>600</b>	<b>1000</b>	<b>1500</b>
	16 A	-	-	-	-	<b>300</b>	<b>500</b>	<b>700</b>	<b>1300</b>
	20 A	-	-	-	-	-	<b>400</b>	<b>500</b>	<b>1000</b>
	25 A	-	-	-	-	-	-	<b>500</b>	<b>800</b>
	32 A	-	-	-	-	-	-	<b>500</b>	<b>600</b>

Downstream MCB		Upstream MCB							
		DX <sup>3</sup> 50 kA B curve							
		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	-	-	-	<b>500</b>	<b>700</b>	<b>1200</b>	<b>1500</b>	<b>3000</b>
	10 A	-	-	-	-	-	<b>700</b>	<b>1000</b>	<b>1800</b>
	16 A	-	-	-	-	-	-	-	<b>1000</b>
	20 A	-	-	-	-	-	-	-	-
	25 A	-	-	-	-	-	-	-	-
	32 A	-	-	-	-	-	-	-	-

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCB							
		DX <sup>3</sup> 50 kA D curve							
		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A
DX <sup>3</sup> 6000 / 10 kA C and D curves	6 A	<b>120</b>	<b>192</b>	<b>240</b>	<b>500</b>	<b>700</b>	<b>1200</b>	<b>1500</b>	<b>3000</b>
	10 A	-	<b>192</b>	<b>240</b>	<b>300</b>	<b>500</b>	<b>700</b>	<b>1000</b>	<b>1800</b>
	13 A	-	-	<b>240</b>	<b>300</b>	<b>400</b>	<b>600</b>	<b>1000</b>	<b>1500</b>
	16 A	-	-	<b>240</b>	<b>300</b>	<b>384</b>	<b>500</b>	<b>700</b>	<b>1300</b>
	20 A	-	-	-	<b>300</b>	<b>384</b>	<b>480</b>	<b>600</b>	<b>1000</b>
	25 A	-	-	-	-	<b>384</b>	<b>480</b>	<b>600</b>	<b>800</b>
	32 A	-	-	-	-	-	<b>480</b>	<b>600</b>	<b>756</b>

### Discrimination with upstream MCCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCCB							
		DPX <sup>3</sup> 160 16 kA à 50 kA							
		16 A	25 A	40 A	63 A	80 A	100 A	125 A	160 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	10 A	<b>5000</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	13 A	-	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	16 A	-	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	20 A	-	<b>5000</b>	<b>5000</b>	<b>5000</b>	<b>5000</b>	<b>6000</b>	<b>T</b>	<b>T</b>
	25 A	-	-	<b>4500</b>	<b>4500</b>	<b>4500</b>	<b>4500</b>	<b>T</b>	<b>T</b>
	32 A	-	-	-	<b>3000</b>	<b>4000</b>	<b>4000</b>	<b>T</b>	<b>T</b>

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCCB							
		DPX <sup>3</sup> 160 16 kA à 50 kA							
		16 A	25 A	40 A	63 A	80 A	100 A	125 A	160 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	<b>6000</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	10 A	<b>5000</b>	<b>7500</b>	<b>7500</b>	<b>7500</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	16 A	-	<b>6000</b>	<b>6000</b>	<b>6000</b>	<b>6000</b>	<b>T</b>	<b>T</b>	<b>T</b>
	20 A	-	<b>5000</b>	<b>5000</b>	<b>5000</b>	<b>5000</b>	<b>6000</b>	<b>T</b>	<b>T</b>
	25 A	-	-	<b>4500</b>	<b>4500</b>	<b>4500</b>	<b>4500</b>	<b>8500</b>	<b>T</b>
	32 A	-	-	-	<b>3000</b>	<b>4000</b>	<b>4000</b>	<b>7000</b>	<b>T</b>

Downstream MCB		Upstream MCCB		
		DPX <sup>3</sup> 250		
		40 A	100 A	160 à 250 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	<b>T</b>	<b>T</b>	<b>T</b>
	10 A	<b>T</b>	<b>T</b>	<b>T</b>
	13 A	<b>8000</b>	<b>T</b>	<b>T</b>
	16 A	<b>6000</b>	<b>T</b>	<b>T</b>
	20 A	<b>5000</b>	<b>8000</b>	<b>T</b>
	25 A	<b>4000</b>	<b>6000</b>	<b>T</b>
	32 A	-	<b>5000</b>	<b>T</b>

. T = Total discrimination



# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCCB		
		DPX <sup>3</sup> 250		
		40 A	100 A	160 à 250 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	T	T	T
	10 A	T	T	T
	16 A	6000	T	T
	20 A	5000	8000	T
	25 A	-	6000	T
	32 A	-	5000	T

Downstream MCB		Upstream MCCB				
		DPX 250 / DPX-H 250 Thermal-magnetic				
		25 A	40 A	63 A	100 A	160 à 250 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	6000	6000	6000	T	T
	10 A	5000	5000	5000	T	T
	13 A	4000	4000	4000	T	T
	16 A	4000	4000	4000	T	T
	20 A	-	4000	4000	8000	T
	25 A	-	3000	3000	6000	T
	32 A	-	-	2000	5000	T

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCCB				
		DPX 250 / DPX-H 250 Thermal-magnetic				
		25 A	40 A	63 A	100 A	160 à 250 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	<b>6000</b>	<b>6000</b>	<b>6000</b>	<b>T</b>	<b>T</b>
	10 A	<b>5000</b>	<b>5000</b>	<b>5000</b>	<b>T</b>	<b>T</b>
	16 A	-	<b>4000</b>	<b>4000</b>	<b>T</b>	<b>T</b>
	20 A	-	<b>4000</b>	<b>4000</b>	<b>8000</b>	<b>T</b>
	25 A	-	-	<b>3000</b>	<b>6000</b>	<b>T</b>
	32 A	-	-	<b>2000</b>	<b>5000</b>	<b>T</b>

Downstream MCB		Upstream MCCB				
		DPX 250 / DPX-H 250 Electronic				DPX / DPX-H 630 / 1250 / 1600 DMX <sup>3</sup> 2500 / 4000
		40 A	100 A	160 A	250 A	160 à 4000 A
DX <sup>3</sup> 6000 / 10 kA C curve	6 A	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	10 A	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	13 A	<b>8000</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	16 A	<b>6000</b>	<b>T</b>	<b>T</b>	<b>T</b>	<b>T</b>
	20 A	<b>5000</b>	<b>8000</b>	<b>T</b>	<b>T</b>	<b>T</b>
	25 A	<b>4000</b>	<b>6000</b>	<b>T</b>	<b>T</b>	<b>T</b>
	32 A	-	<b>5000</b>	<b>T</b>	<b>T</b>	<b>T</b>

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 5. GENERAL CHARACTERISTICS *(continued)*

### Discrimination with upstream MCCBs:

. Discrimination limit with a voltage of 400 V ~ (Values in A)

Downstream MCB		Upstream MCCB				
		DPX 250 / DPX-H 250 Electronic				DPX / DPX-H 630 / 1250 / 1600 DMX <sup>3</sup> 2500 / 4000
		40 A	100 A	160 A	250 A	160 à 4000 A
DX <sup>3</sup> 6000 / 10 kA D curve	6 A	T	T	T	T	T
	10 A	T	T	T	T	T
	16 A	6000	T	T	T	T
	20 A	5000	8000	T	T	T
	25 A	-	6000	T	T	T
	32 A	-	5000	T	T	T

Downstream MCB		Upstream MCCB	
		DPX 250 ER AB	DPX 400 AB
		90 à 240 A	320 et 400 A
DX <sup>3</sup> 6000 / 10 kA C et D curves	6 A	T	T
	10 A	T	T
	13 A	T	T
	16 A	T	T
	20 A	T	T
	25 A	T	T
	32 A	T	T

. T = Total discrimination

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 6. COMPLIANCE AND APPROVALS

### In accordance with standards:

- . EN/IEC 60898-1

### Usage in special conditions:

- . Category C compliant (testing temperature range from -25°C to +70°C, resistant to salt spray) in accordance with the classification defined in Appendix Q of standard IEC/EN 60947-1

### Respect for the environment – Compliance with European Union Directives:

- . Compliance with Directive 2002/95/EC of 27/01/03 known as "RoHS" which provides for a restriction on the use of dangerous substances such as lead, mercury, cadmium, hexavalent chromium and polybrominated biphenyl (PBB) and polybrominated diphenyl ether (PBDE) brominated flame retardants from 1<sup>st</sup> July 2006
- . Compliance with the Directive 91/338/EEC of 18/06/91 and decree 94-647 of 27/07/04

### Plastic materials:

- . Halogen free plastic materials.
- . Labelling of parts compliant with ISO 11469 and ISO 1043.

### Packaging:

- . Design and manufacture of packaging compliant with decree 98-638 of 20/07/98 and Directive 94/62/EC

### Approvals obtained:


- . France: NF

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 7. CUVES

Thermal-magnetic tripping curve range typical of C and D curves MCBs:

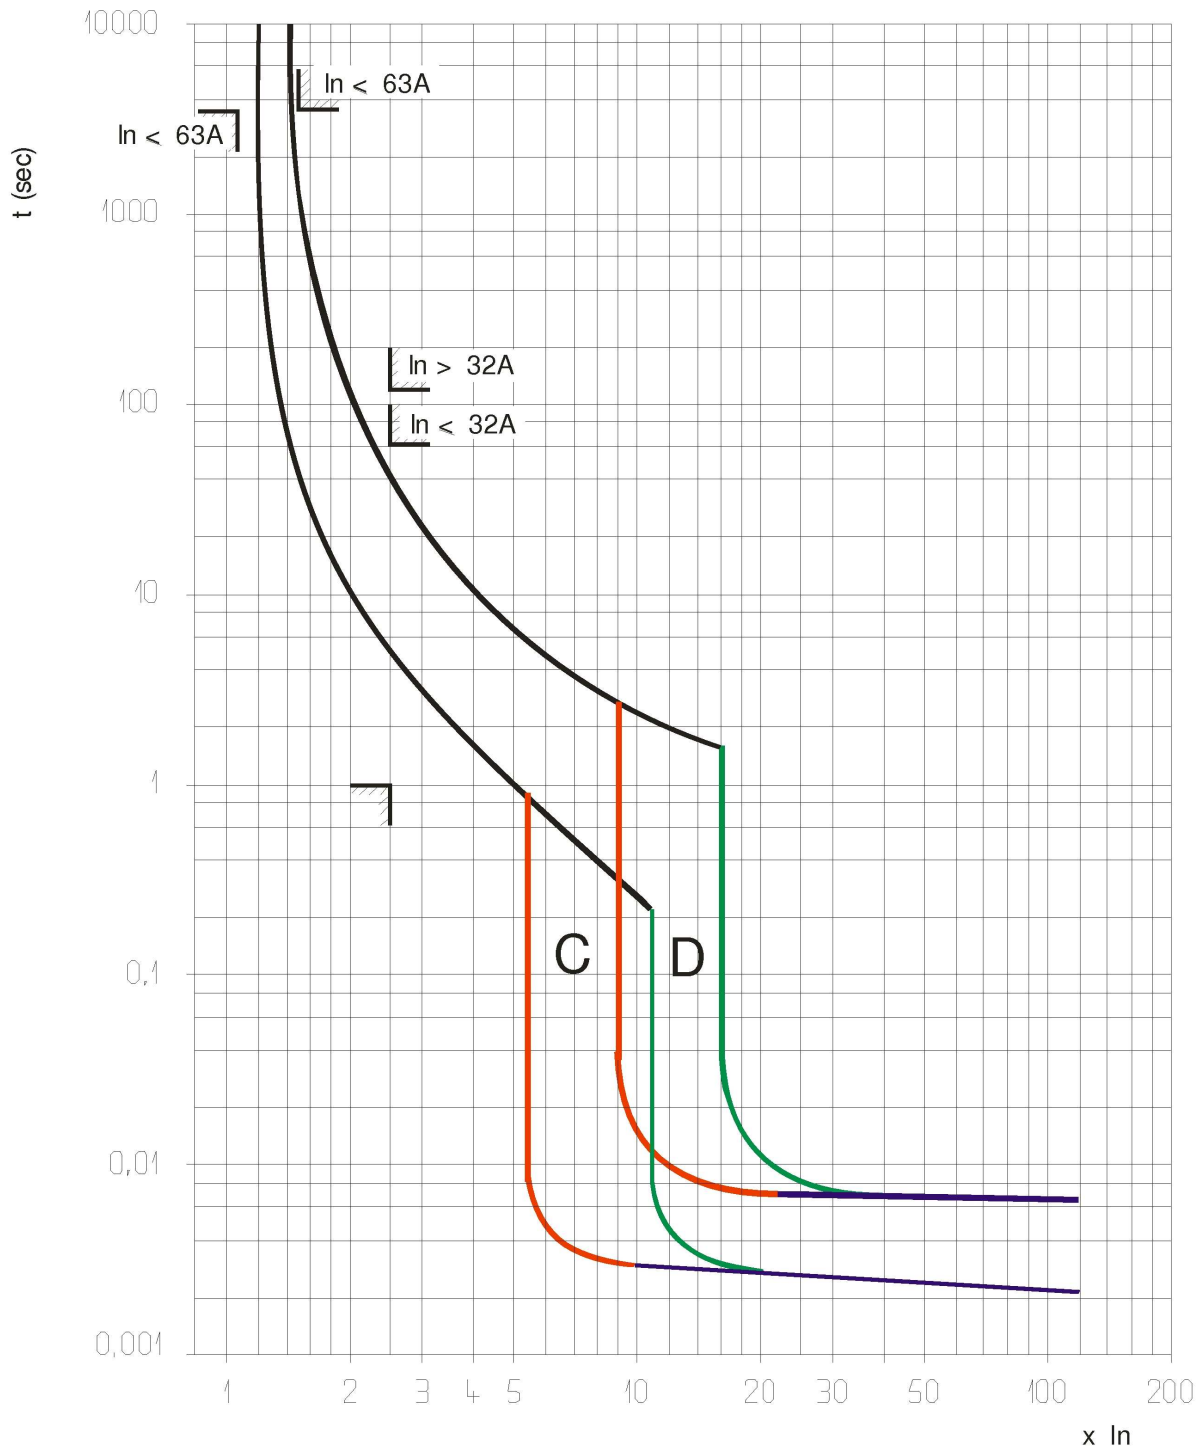

Standard limits

Thermal tripping at ambient temperature = 30°C


$I_n$  = circuit breaker rated current

# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 7. CURVES (continued)

Average thermal-magnetic tripping curves range typical of C curve MCBs:

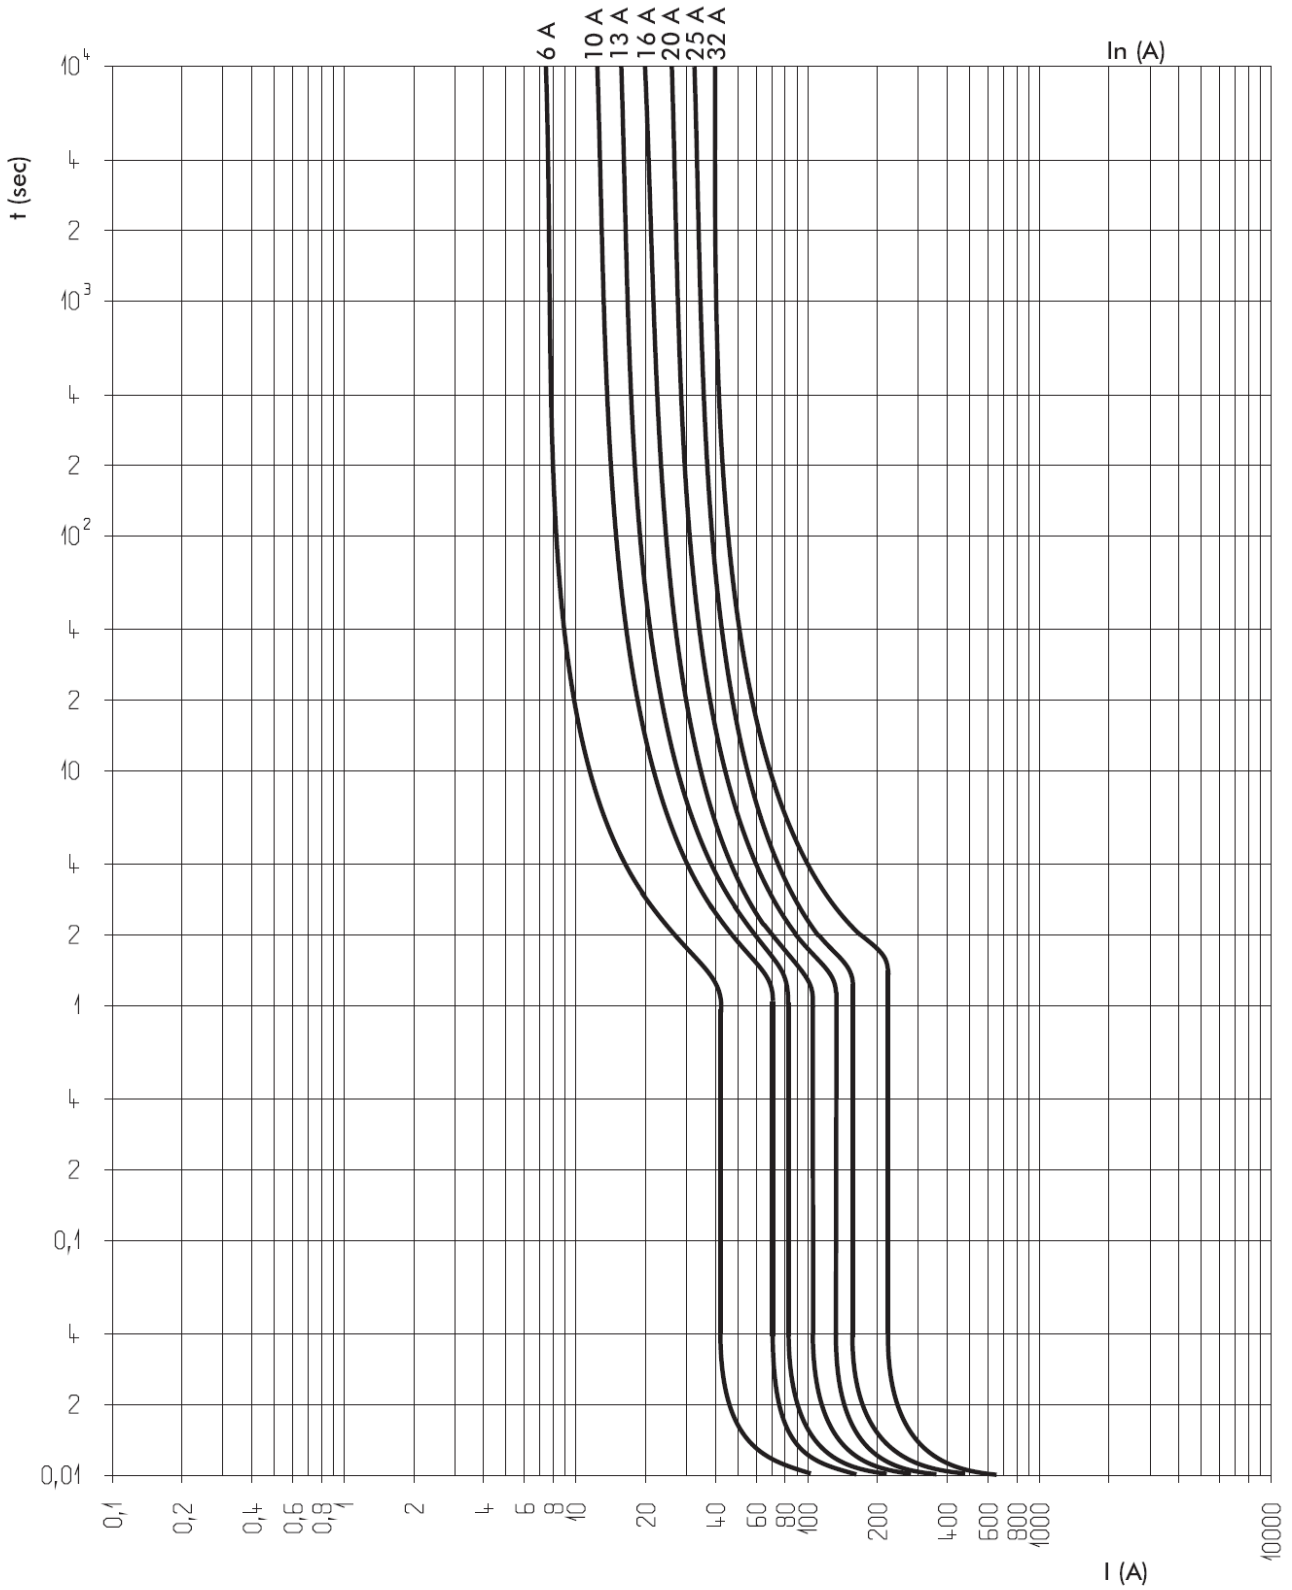


# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 7. CURVES (continued)

Average thermal-magnetic tripping curves range typical of D curve MCBs:

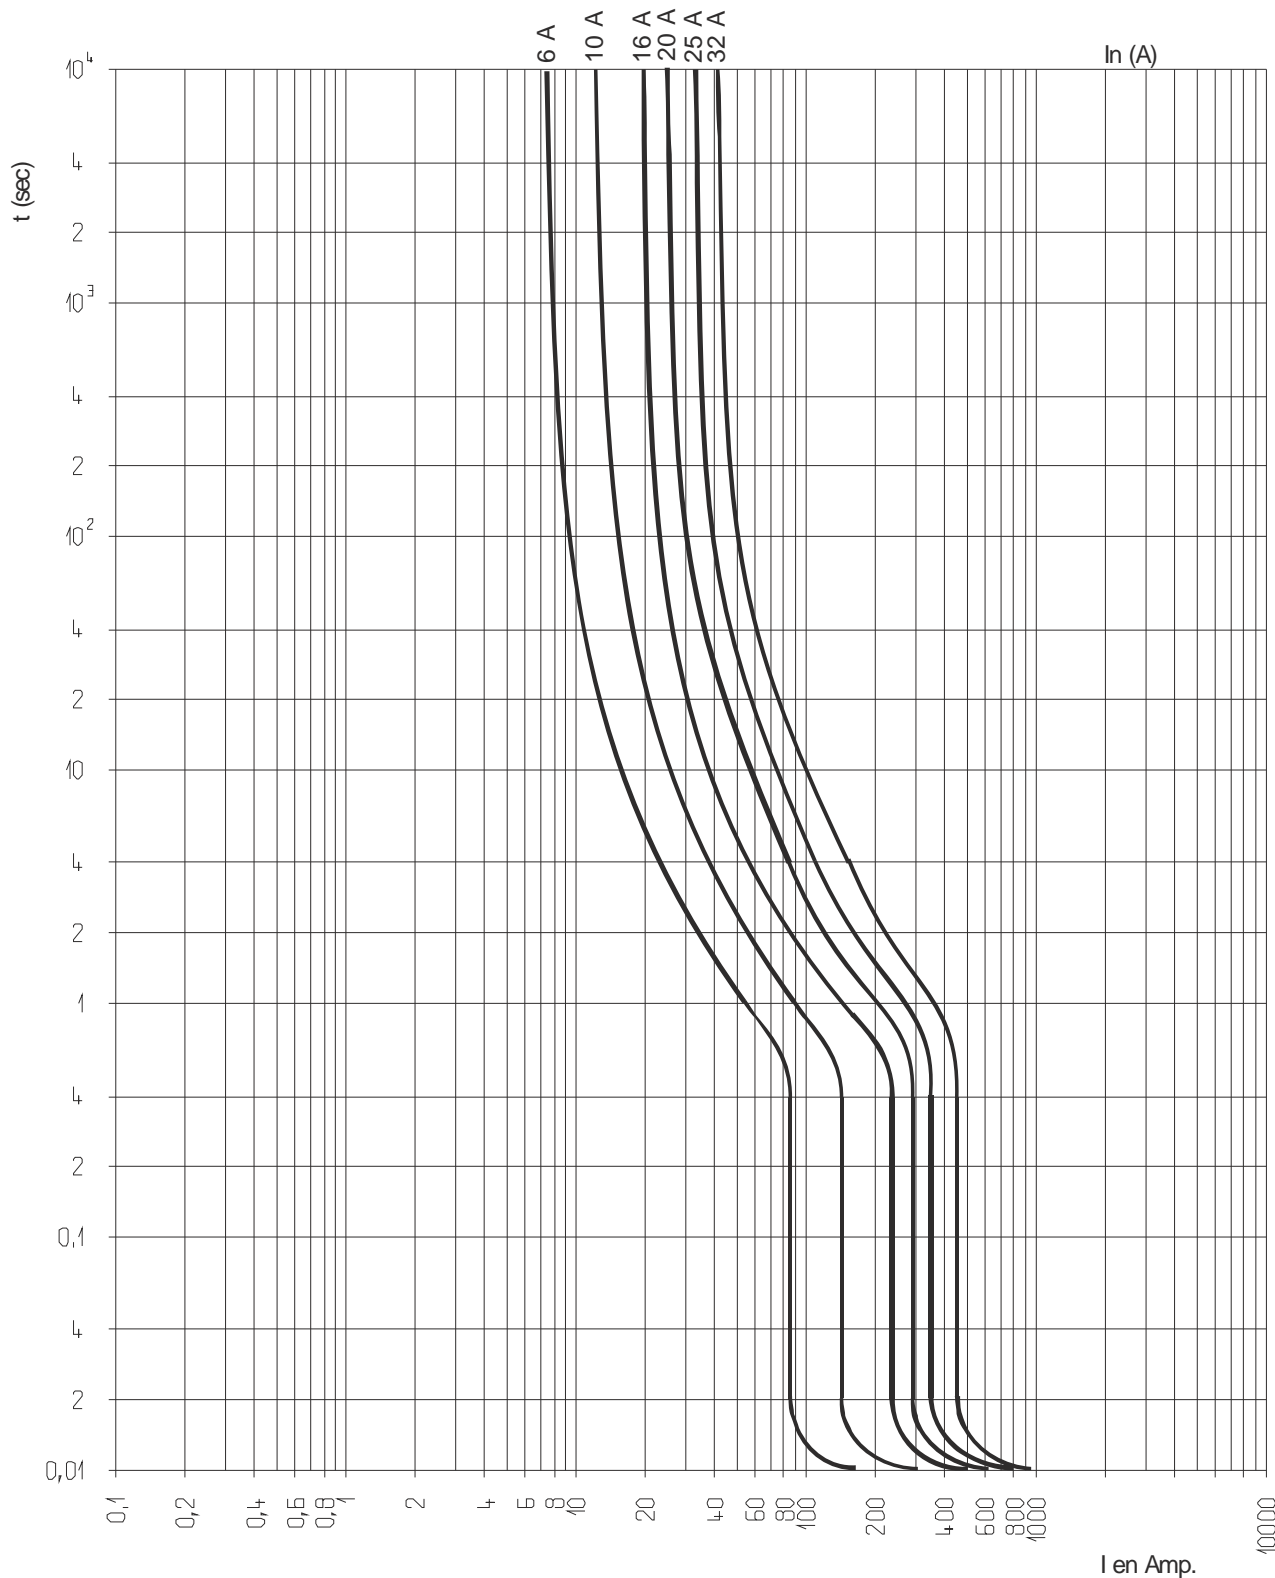


# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 7. CURVES (continued)

### Current limiting curves:

. C and D curves MCB from 6 A to 32 A

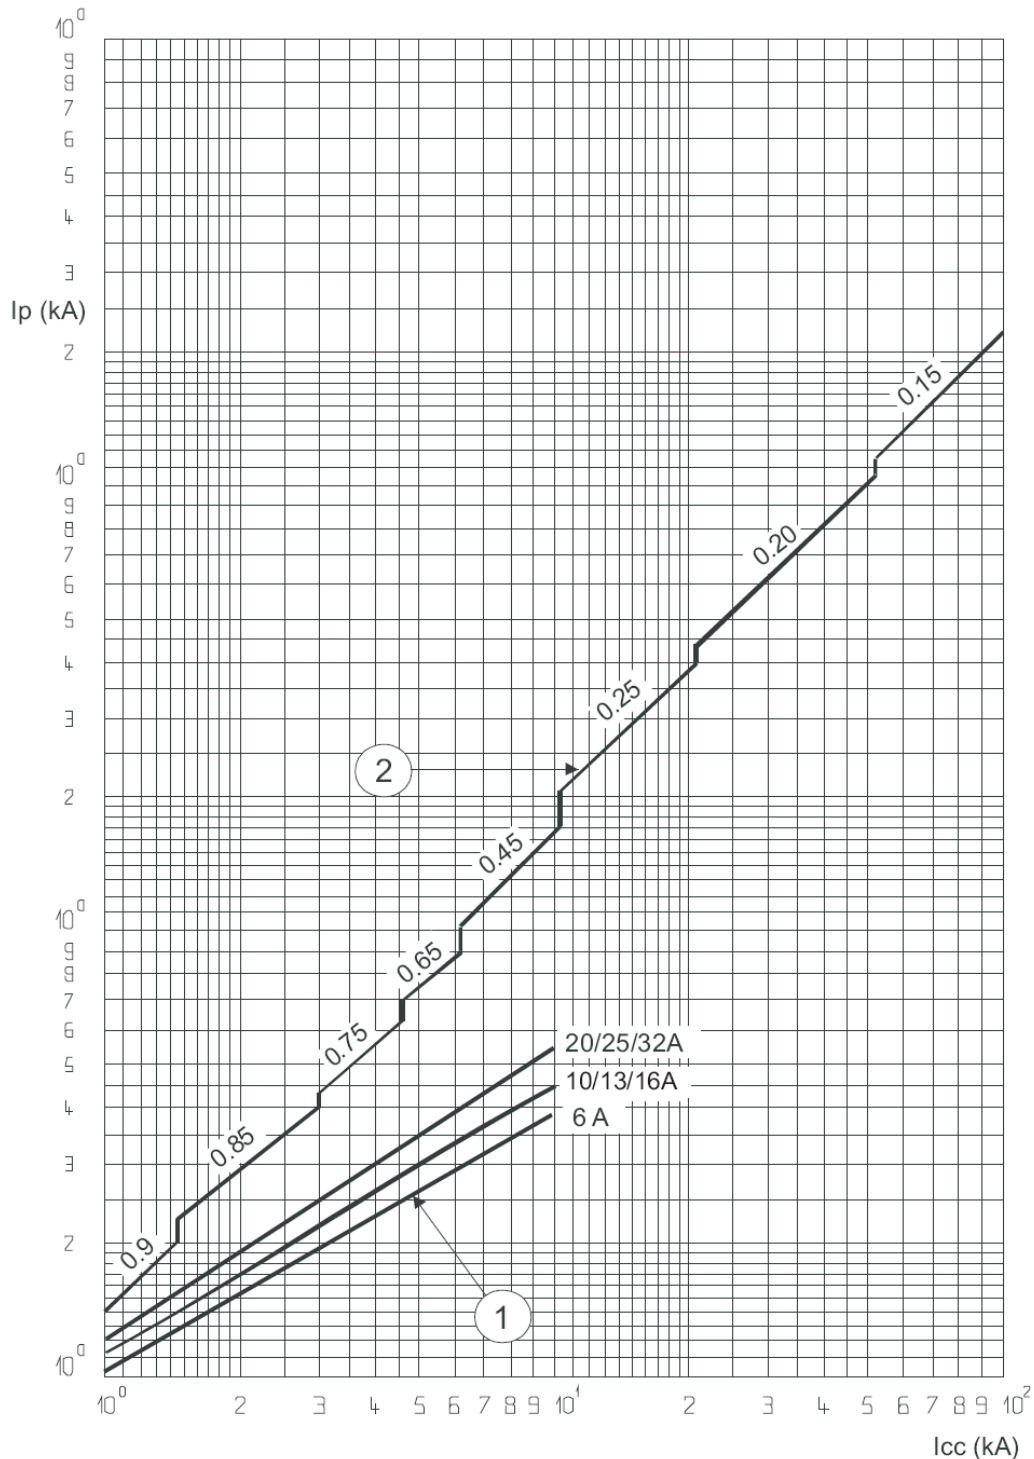

$I_{cc}$  = Prospective short-circuit symmetrical current (rms value in kA)

$I_p$  = Maximum peak value (in kA)

1 = Short-circuit rms current (max. peak)

2 = Unlimited peak currents (max.), corresponding to power factors shown above (0.15 to 0.9)




# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 7. CURVES (continued)

### Thermal stress limiting curves:

. C curve MCBs from 6 A to 32 A (400 V/50 Hz)

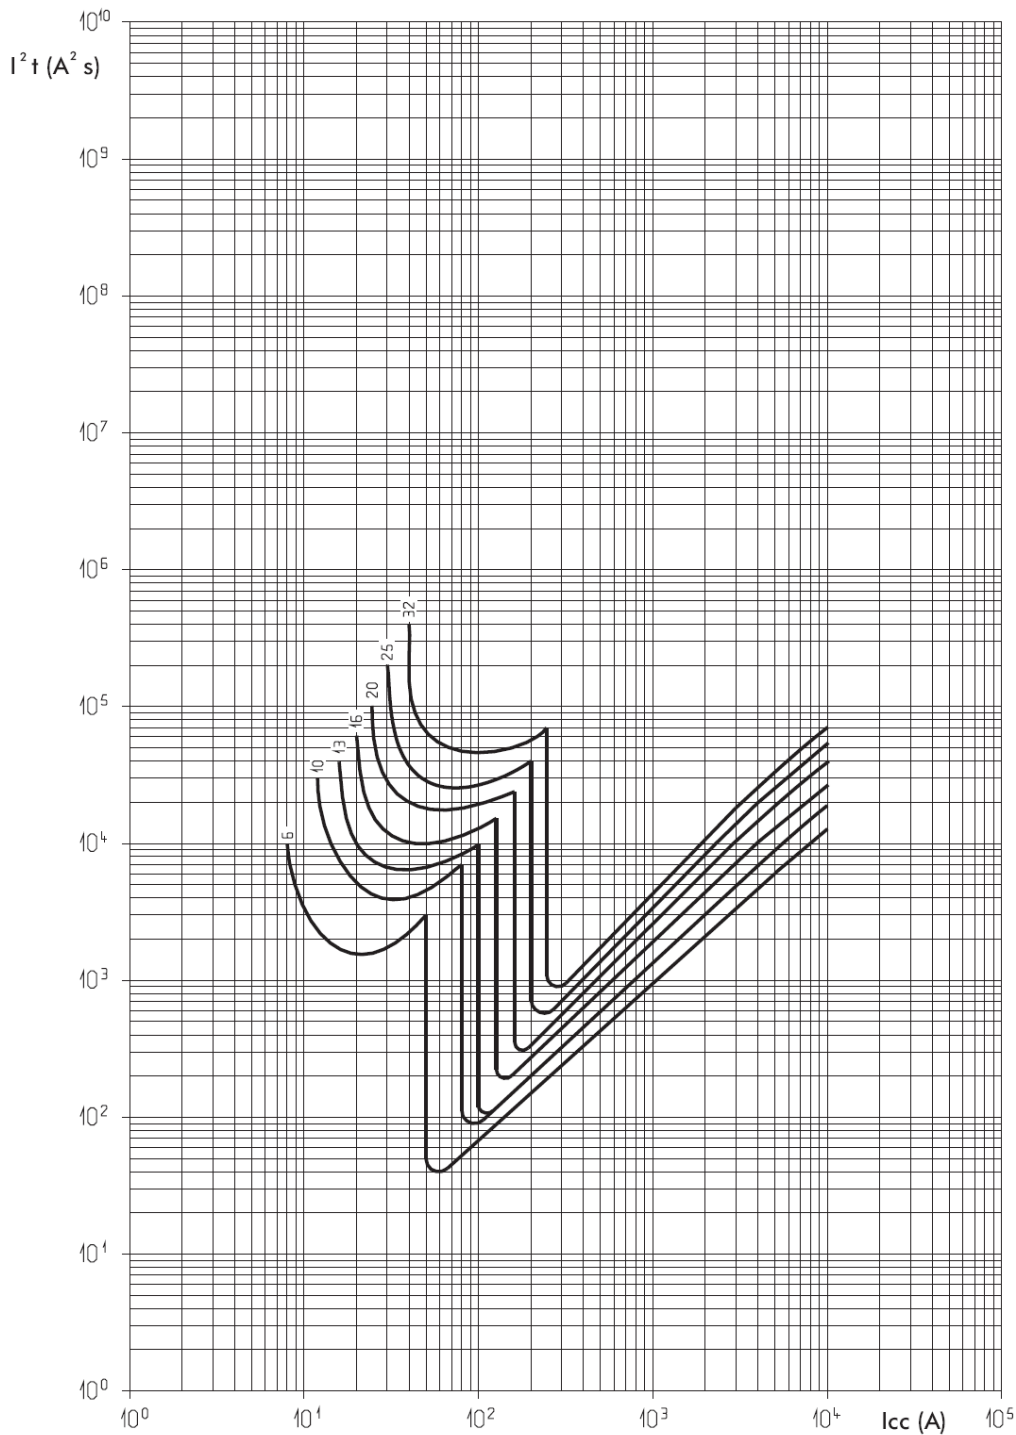

$I_{cc}$  = courant symétrique de court-circuit présumé  
(valeur efficace en A)

$I^2t$  = contrainte thermique limitée (en  $A^2 s$ )


# DX<sup>3</sup> MCB 6000 A / 10 kA 3P and 4P up to 32 A

Cat. N°(s): 4 078 36 to 4 078 41, 4 079 05 to 4 079 10,  
4 079 25, 4 080 66 to 4 080 71, 4 081 24 to 4 081 29

## 7. CURVES (continued)

### Thermal stress limiting curves:

. D curve MCBs from 6 A to 32 A (400 V/50 Hz)

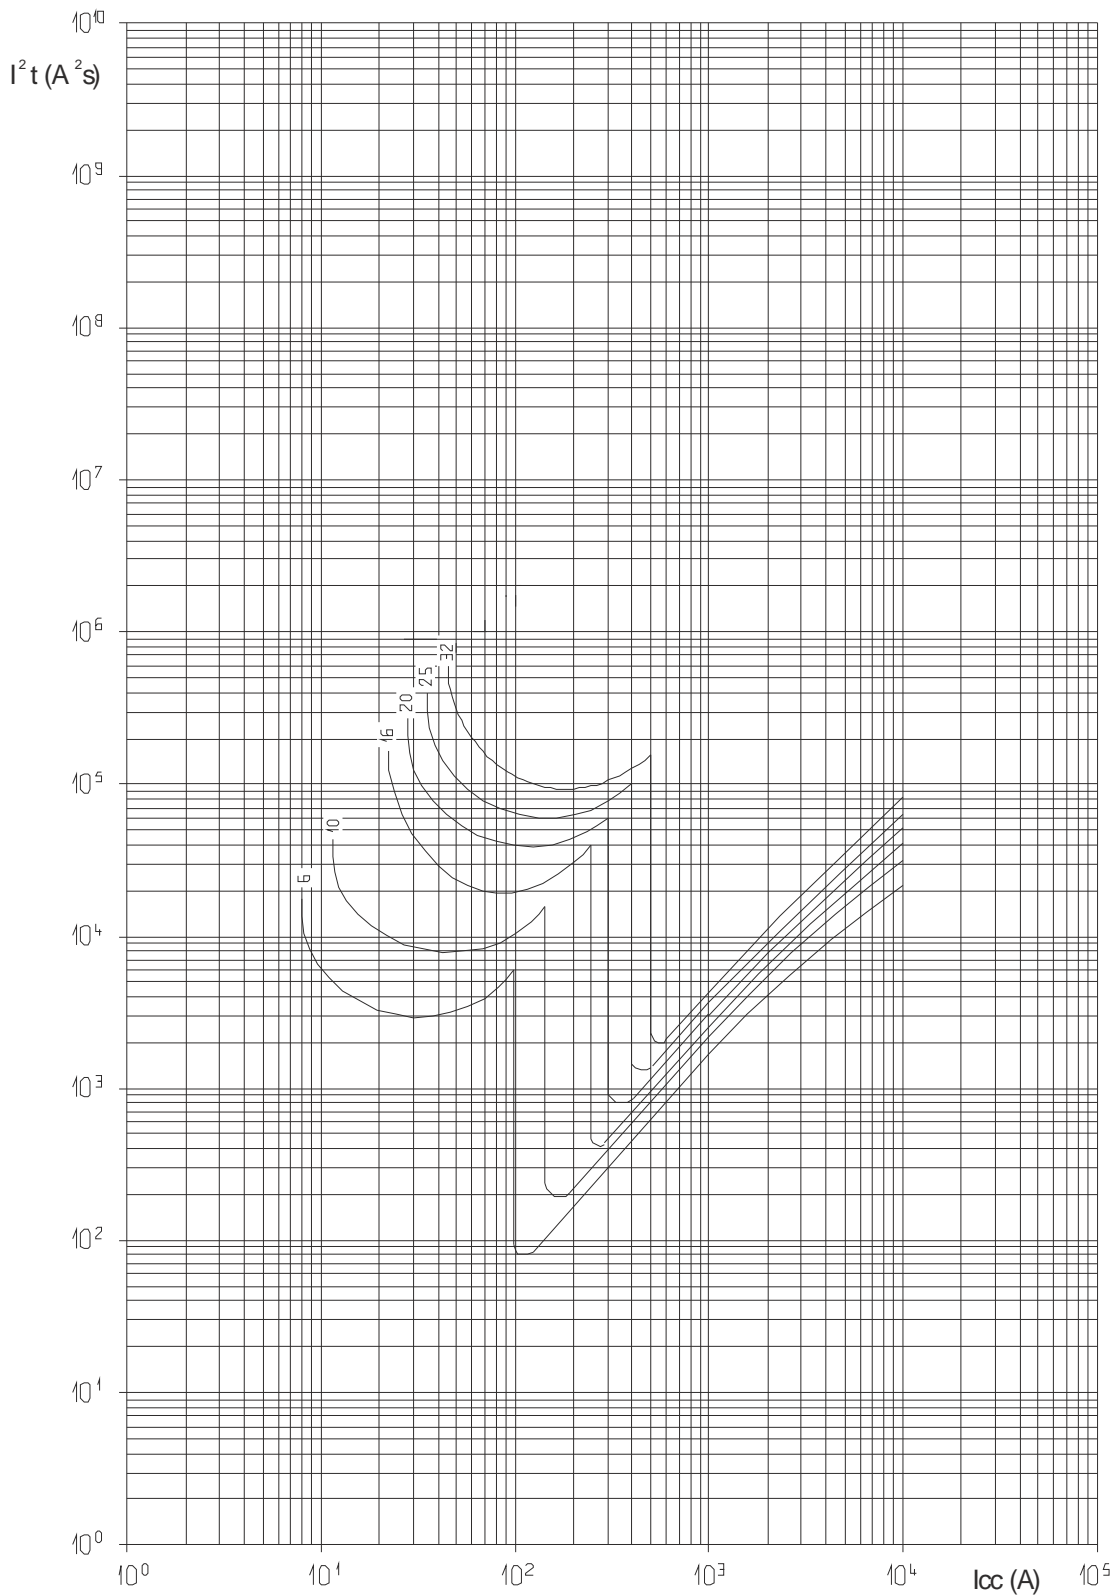

## 8. EQUIPMENT AND ACCESSORIES

### Wiring accessories:

- . HX<sup>3</sup> 4-pole "screw" supply busbar (Cat. No. 405 210) and 4-pole "head of group" supply busbar (Cat. No. 4 052 00 / 01 / 02)
- . Connection terminals (Cat. No. 4 049 05)
- . Sealable screwcover (Cat. No. 4 063 04)

### Signalling auxiliaries:

- . Auxiliary contact (0.5 module, Cat. No. 4 062 58)
- . Fault signalling contact (0.5 module, Cat. No. 4 062 60)
- . Auxiliary contact that can be changed into fault signalling contact (0.5 module, Cat. No. 4 062 62)
- . Auxiliary contact + fault signalling contact that can be changed into 2 auxiliary contacts (1 module, Cat. No. 4 062 66)

### Control auxiliaries:

- . Shunt trip (1 module, Cat. No. 4 062 76 / 78)
- . Under voltage release (1 module, Cat. No. 4 062 80 / 82)
- . Stand-alone release for N/C push-button (1.5 module, Cat. No. 4 062 87)
- . Power Overvoltage Protection (1 module, Cat. No. 4 062 86)

### Motor driven control modules:

- . Motor-driven control module (1 module, Cat. No. 4 062 91)
- . Motor-driven control module with integrated automatic reset (2 modules, Cat. No. 4 062 93 / 95)

### Possible combinations of auxiliaries and circuit breakers:

- . The auxiliaries are installed to the left of the circuit breakers
- . Maximum number of auxiliaries = 3
- . Maximum number of 1 module signalling auxiliaries = 2
- . Maximum number of control auxiliaries (Cat. Nos. 4 062 76 to 4 062 87) = 1
- . The control auxiliary trip (Cat. Nos. 4 062 76 to 4 062 87) must mandatorily be placed to the left of the signalling auxiliaries (Cat. Nos. 4 062 58 to 4 062 66) where the auxiliaries from these 2 families are connected to the same circuit breaker

### Sealing:

- . Possible in the open or closed positions

### Locking options:

- . Via padlock 5 mm in diameter (Cat. No. 4 063 13) or padlock 6 mm in diameter (Cat. No. 0 227 97) and padlock support (Cat. No. 4 063 03)

### Installation software:

- . XL PRO<sup>3</sup>