


DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

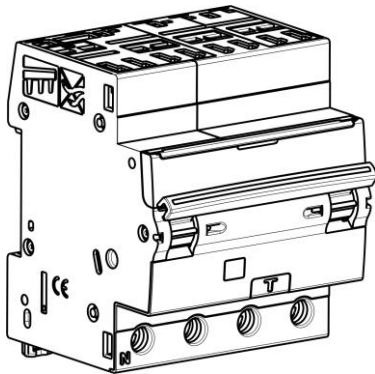


CONTENTS	PAGE
1. Description, use	1
2. Range	1
3. Overall dimensions.....	1
4. Preparation - Connection	1
5. General characteristics.....	2
6. Compliance and approvals.....	13
7. Curves	14
8. Auxiliaries and accessories	19
9. Safety	19

1. DESCRIPTION - USE

Residual Current Operated Circuit Breaker (RCBO) with positive contact indication for control, protection against short circuits and overload and isolation of electrical circuits, protecting people from direct and indirect contact and protecting installations from insulation faults.

Symbol :



Technology :

- . Limiting device
- . Simultaneous control of all poles for closing and opening (trip-free mechanism)

2. RANGE

Polarity :

- 4 protected poles

Width :

- . 4 modules (4 x 17.8 mm = 71,2 mm)

Rated currents In :

- 10 – 13 – 16 – 20 – 25 – 32 A

Magnetic tripping curve :

- . C (between 5 and 10 In)

Type :

- . A (residual current with a DC component)

Sensitivity – Operating time :

- . 30 mA - instantaneous

2. RANGE (continued)

Rated voltage and frequency :

- . 400 V~ / 415 V~, 50 Hz with standard tolerances


Maximum operating voltage :

- . 440 V~, 50 Hz with standard tolerances

Breaking capacity :

- . Icn = 6000 A in accordance with standard EN/IEC 61009-1
- . Icu = 10 kA in accordance with standard EN/IEC 60947-2

3. OVERALL DIMENSIONS

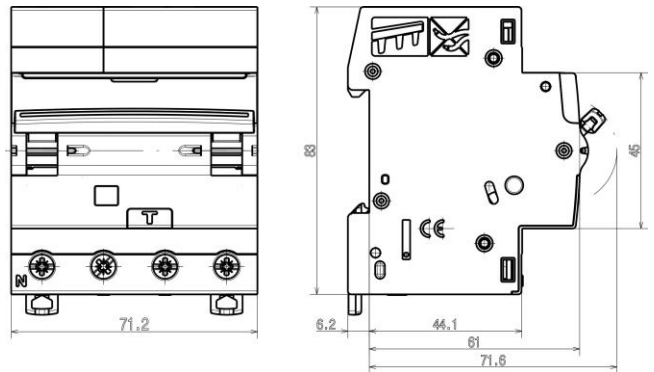


4. PREPARATION - CONNECTION

Mounting :

- . On symmetrical EN 60.715 rail or DIN 35 rail

Operating positions :

- . Vertical horizontal upside down On the side

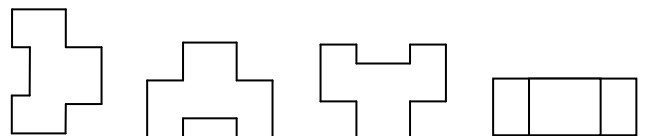

Power supply :

- . Top supply and connection by automatic terminal: without tools, by simply inserting optimized HX3 busbar (ref 4052 00, 01, 02).


DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

4. PREPARATION - CONNECTION *(continued)*

400V three-phase network wiring without neutral

. Connect the 3 phases as indicated by the arrows in below diagram

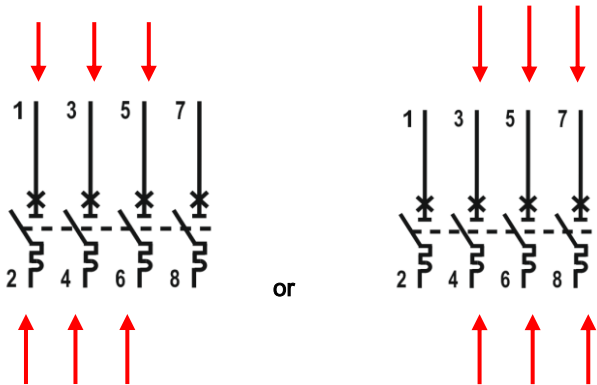

Connection :

- . Terminals protected against direct contact IP20, when device wired
- . Cage terminals, with release and captive screws
- . Terminals fitted with shutters preventing a cable being placed under the terminal, with the terminal partly open or closed
- . Alignment and spacing of the terminals permitting connection with the other products via prong and fork-type (biconnect) supply busbars
- . Terminal depth: 13 mm upstream and 13 mm downstream
- . Screw head: mixed, slotted and Pozidriv no. 2
- . Tightening torque:
 - Recommended: 2.5 Nm
 - Min.: 1.2 Nm
 - Max.: 3.5 Nm

Conductor type :

- Upper part of the product, automatic terminals
 - . Pin Busbar
- Lower part of the product, screw terminals
 - . Busbar fork 4 poles
 - . Pin Busbar 4 poles, alone or with a flexible wire (without ferrule) 16 mm² or a terminal in the same terminal
 - . Copper cable - Cable cross-section:

	Without ferrule	With ferrule
Rigid cable	1 x 0.75 mm ² to 35 mm ² 2 x 0.75 mm ² to 16 mm ²	-
Flexible cable	1 x 0.75 mm ² to 25 mm ² 2 x 0.75 mm ² to 16 mm ²	1 x 0.75 mm ² to 25 mm ²

4. PREPARATION - CONNECTION *(continued)*

Recommended tools :

- . For the screw terminals, screwdriver with 5.5 mm to 6.5 mm blade or Pozidriv no. 2 screwdriver
- . For attaching or removing the DIN rail, screwdriver with 5.5 mm to 6.5 mm blade or Pozidriv no. 2 screwdriver

Manual actuation of the RCBO :

- . Ergonomic 2-position handle:
- "O-OFF": Device open
- "I-ON": Device closed

Contact status display :

- . By marking of the handle:
- "O-OFF" in white on a green background = contacts open
- "I-ON" in white on a red background = contacts closed

Trip indication on residual current fault :

- . Yellow indicator on the front

Locking :


- . Padlocks possible in the open or closed positions with padlock support (Cat. No. 4 063 03) and Ø 5 mm padlock (Cat. No. 4 063 13) or Ø6 mm padlock (Cat. No. 227 97)

Sealing :

- . Possible in the open or closed positions

Labelling :

- . Circuit identification by way of a label inserted in the label holder situated on the front of the product

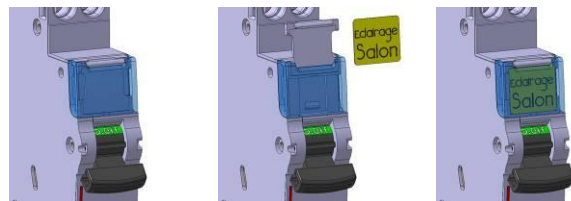

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14


5. GENERAL CHARACTERISTICS

Neutral earthing system :

. IT , TT, TN


Marking on the front side :

. By permanent ink pad printing

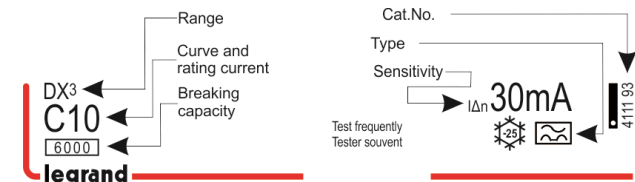

Marking on the upper panel :

. By permanent ink pad printing

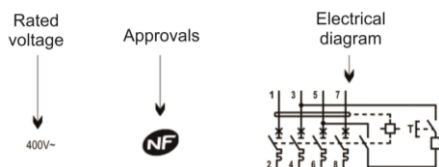

Test operating voltages :

$I_{\Delta n}$	30 mA
U mini	320 V ~
U maxi	440 V ~

Breaking capacity :

. With a three-phase network + neutral (with alternating current 50 Hz)

Standard	Voltage between phases	Breaking capacity	
EN 61009-1	I_{cn} (rated)	400 V	6 kA
EN 60947-2	I_{cu}	400 V	10 kA
	I_{cs}	400 V	50 % I_{cu}

5. GENERAL CHARACTERISTICS (continued)

Residual breaking capacity :

. $I_{\Delta m} = 4.5$ kA in accordance with EN 61009-1 section 9.12.11.4d ($I_{\Delta m}$: short-circuit to earth)

Breaking capacity on one single pole (phase pole) :

. In accordance with I_{TT} EN60947-2 – Appendix H (double fault in IT system): 3 kA at 400 V ~

Isolation distance :

. The distance between the contacts is greater than 5.5 mm with the handle in the open position. The RCBO is suitable for isolation in accordance with standard EN/IEC 61009-1

Insulation voltage :

. $U_i = 500$ V in accordance with standard EN/IEC 61009-1

Degree of pollution :

. 2 in accordance with standard EN/IEC 61009-1

Dielectric strength :

. 3,500 V

Rated impulse withstand voltage :

. $U_{imp} = 4$ kV (wave 1.2/50 μ s)

Protection from false tripping :

. 8/20 μ s wave resistance: 250 A

. 0.5 μ s/100 kHz damped recurring wave resistance: 200 A

5. GENERAL CHARACTERISTICS *(continued)*

Degree or class of protection :

- . Terminals protected against direct contact, Class of protection against solid objects and liquids (wired device): IP20 in accordance with standards IEC 529 – EN 60529 and NF 20-010
- . Front panel protected against direct contact: IP 40
- . Class II in relation to metallic conductive parts
- . Class of protection against mechanical impacts IK 02 in accordance with standard EN 62262.

Plastic materials :

- . Polyamide and P.B.T.

Enclosure heat and fire resistance :

- . Resistance to glow wire tests at 960°C, in accordance with standard IEC/EN 61009-1
- . Classification V0, in accordance with standard UL94

Higher heating potential :

- . The heat potential of a 30 mA AC type C16 device is estimated at: 4.73 MJ

Closing and opening force via the handle :

- . 6 N on opening
- . 20 N on closing

Mechanical endurance :

- Compliant with standard EN/IEC 61009-1
- . Tested with 20,000 operations with no load

Electrical endurance :

- Compliant with standard EN/IEC 61009-1
- . Tested with 10,000 operations with load (at $I_n \times \cos(\varphi 0.9)$)
- . Tested with 2,000 residual current trip operations using the Test button or the fault current

Ambient temperatures :

- . Operation: from – 25°C to + 60°C
- . Storage: from – 40°C to + 70°C

DC operation :

- . Cannot be used with DC

Frequency :

- . Operation at 400 Hz: No
- . Operation at 60 Hz: No

5. GENERAL CHARACTERISTICS *(continued)*

Sinusoidal vibration resistance (in accordance with IEC 60068.2.6) :

- . Axes: x - y - z
- . Frequency: 10 to 55 Hz
- . Acceleration: 3g ($1g = 9.81 \text{ m.s}^{-2}$)

Resistance to tremors :

- . In accordance with standard EN/IEC 61009-1

Packaged volume :

	Volume (dm ³)	Packaging
For all ratings	0.7	Per 1

Derating of RCBOs function of the number of devices placed side by side :

When several RCBOs are installed side by side and operate simultaneously, the heat dissipation of one pole is limited. This results in an increased operating temperature for the RCBOs causing false tripping. Applying the following additional coefficients to the operating currents is recommended.

Number of RCBOs side by side	Coefficient
2 - 3	0.9
4 - 5	0.8
6 - 9	0.7
≥ 10	0.6

These values are provided by recommendation IEC 60439-1 and the standards NF C 63421 and EN 60439-1.

In order to avoid having to use these coefficients there must be good ventilation and the devices must be kept apart using the spacing elements Cat. No. 4 063 07 (0.5 module).

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

5. GENERAL CHARACTERISTICS *(continued)*

Derating of RCBOs in the event of use with fluorescent tubes :

Electronic or ferromagnetic ballasts provide a high inrush current for a very short time. These currents are liable to cause tripping of the RCBOs .

The maximum number of ballasts per RCBOs stated by the lamp and ballast manufacturers in their catalogues should be taken into account during installation.

Impact of height :

	2000 m	3000 m	4000 m	5000 m
Dielectric strength	3500 V	2500 V	2000 V	1500 V
Maximum operating voltage	400 V	400 V	400 V	400 V
Derating at 30°C	none	none	none	none

Derating of RCBOs depending on the ambient temperature :

. The nominal characteristics of a RCBO are modified depending on the ambient temperature which prevails in the cabinet or enclosure where the RCBO is located.

. Reference temperature: 30°C in accordance with standard IEC/EN 60947-2.

In (A)	Ambient Temperature/In								
	- 25°C	- 10°C	0°C	10°C	20°C	30°C	40°C	50°C	60°C
10	13	12	12	11	11	10	10	10	10
13	17	16	15	14	14	13	13	13	13
16	20	19	18	18	17	16	16	16	16
20	26	24	23	22	21	20	20	20	20
25	32	30	29	28	26	25	25	25	25
32	41	38	37	35	34	32	32	32	32

Dissipated power for the phase pole in In :

Rated current	10 A	13 A	16 A	20 A	25 A	32 A
Power (W)	4,7 W	5,7 W	8.9 W	9,3 W	10,4 W	12,3 W

Specific use:

. Appropriate to operate in humid atmosphere and polluted by a chlorinated environment (pool-type)

Association and coordination with upstream fuses :

. Three-phase network (+N) 400/415 V, in accordance with standard IEC 60947-2

. TT neutral earthing or TNS system

Downstream RCBO		Upstream fuse									
		gG and aM types									
		≤20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX ³ 6000 A C curve	≤ 13 A	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	16 A	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	20 A	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	25 A	-	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA
	32 A	-	-	-	-	100 kA	100 kA	100 kA	100 kA	100 kA	40 kA

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

5. GENERAL CHARACTERISTICS *(continued)*

Association and coordination with upstream MCBs :

- . Three-phase network (+N) 400/415 V, in accordance with standard IEC 60947-2
- . TT neutral earthing or TNS system

Downstream RCBO		Upstream MCB			
		DX ³ 10 kA B and C curves DX ³ 6000/10 kA B, C and D curves			
		≤ 32 A	40 A	50 A	63 A
DX ³ 6000 A C curve	≤ 25 A	10 kA	10 kA	10 kA	10 kA
	32 A	-	10 kA	10 kA	10 kA

Downstream RCBO		Upstream MCB											
		DX ³ 10000 16 kA B/C/D curves			DX ³ 25 kA B/C/D curves			DX ³ 36 kA C curve			DX ³ 50 kA B/C/D curves		
		≤ 25 A	32 A	40 to 125 A	≤ 25 A	32 A	40 to 125 A	≤ 25 A	32 A	40 to 80 A	≤ 25 A	32 A	40 to 63 A
DX ³ 6000 A C curve	≤ 20 A	16 kA	16 kA	16 kA	25 kA	25 kA	25 kA	36 kA	36 kA	36 kA	50 kA	50 kA	50 kA
	25 A	-	16 kA	16 kA	-	2.5 kA	25 kA	-	36 kA	36 kA	-	50 kA	50 kA
	32 A	-	-	16 kA	-	-	25 kA	-	-	36 kA	-	-	50 kA

Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs) :

- . Three-phase network (+N) 400/415 V, in accordance with standard IEC 60947-2
- . TT neutral earthing or TNS system

Downstream RCBO		Upstream MCCBs											
		DPX ³ 160 16 kA			DPX ³ 160 25 kA			DPX ³ 160 36 kA			DPX ³ 160 50 kA		
		16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A	16 A	25 A	40 to 160 A
DX ³ 6000 A C curve	≤ 13 A	16 kA	16 kA	16 kA	25 kA	25 kA	25 kA	25 kA	25 kA	25 kA	25 kA	25 kA	25 kA
	16 A	-	16 kA	16 kA	-	25 kA	25 kA	-	25 kA	25 kA	-	25 kA	25 kA
	20 A	-	16 kA	16 kA	-	25 kA	25 kA	-	25 kA	25 kA	-	25 kA	25 kA
	25 A	-	-	16 kA	-	-	25 kA	-	-	25 kA	-	-	25 kA
	32 A	-	-	16 kA	-	-	25 kA	-	-	25 kA	-	-	25 kA

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

5. GENERAL CHARACTERISTICS *(continued)*

Association and coordination with upstream Moulded Case Circuit Breakers (MCCBs) :

. Three-phase network (+N) 400/415 V, in accordance with standard IEC 60947-2

. TT neutral earthing or TNS system

Downstream RCBO		Upstream MCCB			
		DPX ³ 250 25 kA	DPX ³ 250 36 kA	DPX ³ 250 50 kA	DPX ³ 250 70 kA
		25 at 250 A	25 at 250 A	25 at 250 A	25 at 250 A
DX ³ 6000 A C curve	≤ 32 A	25 kA	25 kA	25 kA	25 kA

Downstream RCBO		Upstream MCCB	
		DPX ³ 630 36 kA at 100 kA	DPX ³ 1600 36 kA at 100 kA
		250 at 630 A	630 at 1600 A
DX ³ 6000 A C curve	≤ 20 A	25 kA	25 kA
	25 A	25 kA	20 kA
	32 A	25 kA	15 kA

Downstream RCBO		Upstream MCCB	
		DPX ³ 250 ER AB	DPX ³ 400 AB
DX ³ 6000 A C curve	≤ 32 A	25 kA	25 kA

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

5. GENERAL CHARACTERISTICS *(continued)*

Selectivity between two levels of protection

- . The downstream MCB must always have a magnetic threshold and a rated current lower than those of the upstream protection.
- . Selectivity or Discrimination is said to be total (T) if there is discrimination up to the value of breaking capacity (in accordance with standard EN/IEC 60947-2) of the downstream MCB.

Selectivity with upstream fuses :

- . Selectivity limit at 230/400 V~: values in Ampere.

Downstream RCBO		Upstream fuse gG type							
		32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX ³ 6000 A C curve	10 A	-	1600	2200	3200	3600	T	T	T
	13 A	-	1400	1800	2600	3000	5600	T	T
	16 A	-	1400	1800	2600	3000	5600	T	T
	20 A	-	1200	1500	2200	2500	4600	T	T
	25 A	-	-	1300	2000	2200	4100	5500	T
	32 A	-	-	1200	1700	1900	3500	4500	T

T = Total discriminate

Downstream RCBO		Upstream fuse aM type								
		25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A	160 A
DX ³ 6000 A C curve	10 A	-	1100	1700	2500	5000	T	T	T	T
	13 A	-	1000	1400	2100	4000	T	T	T	T
	16 A	-	1000	1400	2100	4000	T	T	T	T
	20 A	-	-	1300	1800	3400	5100	T	T	T
	25 A	-	-	1100	1600	3000	4500	T	T	T
	32 A	-	-	-	1300	2400	3800	5000	T	T

T = Total discriminate

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

5. GENERAL CHARACTERISTICS *(continued)*

Selectivity with upstream modular MCBs :

. Selectivity limit at 230/400 V~: values in Ampere.

		Upstream MCB											
		DX ³ 4500 / 6 kA - DX ³ 6000 / 10 kA - DX ³ 10000 / 16 kA B curve											
Downstream RCBO		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX ³ 6000 A C curve	10 A	-	-	-	80	100	128	160	200	252	3000	5000*	T*
	13 A	-	-	-	-	100	128	160	200	252	2500	4000	6000*
	16 A	-	-	-	-	-	128	160	200	252	2000	3600	5500*
	20 A	-	-	-	-	-	-	160	200	252	1600	3000	4000
	25 A	-	-	-	-	-	-	-	200	252	1300	2400	3300
	32 A	-	-	-	-	-	-	-	-	252	1000	1800	2700

		DX ³ 3000 - DX ³ 4500/6 kA - DX ³ 6000/10 kA - DX ³ 10000/16 kA C curve											
		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX ³ 6000 A C curve	10 A	-	98	120	150	187	240	300	375	472	3000	5000*	T*
	13 A	-	-	120	150	187	240	300	375	472	2500	4000*	6000*
	16 A	-	-	-	150	187	240	300	375	472	2000	3600*	5500*
	20 A	-	-	-	-	187	240	300	375	472	1600	3000	4000*
	25 A	-	-	-	-	-	240	300	375	472	1300	2400	3300*
	32 A	-	-	-	-	-	-	300	375	472	1000	1800	2700

		Upstream MCB											
		DX ³ 4500 / 6 kA - DX ³ 6000 / 10 kA - DX ³ 10000 / 16 kA D curve											
Downstream RCBO		10 A	13 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX ³ 6000 A C curve	10 A	-	-	192	240	300	384	480	600	756	3000	5000	T
	13 A	-	-	-	240	300	384	480	600	756	2500	4000	6000
	16 A	-	-	-	240	300	384	480	600	756	2000	3600	5500
	20 A	-	-	-	-	300	384	480	600	756	1600	3000	4000
	25 A	-	-	-	-	-	384	480	600	756	1300	2400	3300
	32 A	-	-	-	-	-	-	480	600	756	1100	1450	2700

. T = Total discrimination

. *: If the discrimination value stated in the table is greater than the breaking capacity of the upstream circuit breaker then the breaking capacity of the upstream device must be taken as the discrimination value (the discrimination value may not exceed the breaking capacity of the upstream device).

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

5. GENERAL CHARACTERISTICS *(continued)*

Selectivity with upstream modular MCBs :

. Selectivity limit at 230/400 V~: values in Ampere.

Downstream RCBO		DX ³ 25 kA B curve										
		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX ³ 6000 A C curve	10 A	-	-	80	100	500	700	1000	1800	3000	5000	T
	13 A	-	-	-	100	400	600	1200	1500	2500	4000	T
	16 A	-	-	-	-	300	500	700	1300	2000	3600	5500
	20 A	-	-	-	-	-	400	500	1000	1600	3000	4000
	25 A	-	-	-	-	-	-	500	800	1300	2400	3300
	32 A	-	-	-	-	-	-	500	600	1000	1800	2700

Downstream RCBO		DX ³ 25 kA C curve										
		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX ³ 6000 A C curve	10 A	-	120	150	187	500	700	1000	1800	3000	5000	T
	13 A	-	120	150	187	400	600	1200	1500	2500	4000	T
	16 A	-	-	150	187	300	500	700	1300	2000	3600	5500
	20 A	-	-	-	187	300	400	500	1000	1600	3000	4000
	25 A	-	-	-	-	240	400	500	800	1300	2400	3300
	32 A	-	-	-	-	-	300	500	600	1000	1800	2700

Downstream RCBO		Upstream MCB DX ³ 25 kA D Curve										
		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A	100 A	125 A
DX ³ 6000 A C curve	10 A	-	192	240	300	500	700	1000	1800	3000	5000	T
	13 A	-	-	240	300	400	600	1200	1500	2500	4000	T
	16 A	-	-	240	300	384	500	700	1300	2000	3600	5500
	20 A	-	-	-	300	384	480	600	1000	1600	3000	4000
	25 A	-	-	-	-	384	480	600	800	1300	2400	3300
	32 A	-	-	-	-	-	480	600	756	1100	1450	2700

.T = Total discriminate

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

5. GENERAL CHARACTERISTICS *(continued)*

Selectivity with upstream modular MCBs :

. Selectivity limit at 230/400 V~: values in Ampere.

Downstream RCBO		DX ³ 36 kA / DX ³ 50 kA C Curve								
		10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A	80 A
DX ³ 6000 A C curve	10 A	-	120	150	210	500	700	1000	1800	3000
	13 A	-	120	150	200	400	600	1200	1500	2500
	16 A	-	-	150	187	300	500	700	1300	2000
	20 A	-	-	-	187	300	400	500	1000	1600
	25 A	-	-	-	-	240	400	500	800	1300
	32 A	-	-	-	-	-	300	500	600	1000

Downstream RCBO		DX ³ 50 kA B Curve						DX ³ 50 kA D Curve								
		≤ 16 A	20 A	25 A	32 A	40 A	50 A	63 A	10 A	16 A	20 A	25 A	32 A	40 A	50 A	63 A
DX ³ 6000 A C curve	10 A	-	150	210	500	700	1000	1800	-	192	240	300	500	700	1000	1800
	13 A	-	-	200	400	600	1200	1500	-	-	240	300	400	600	1200	1500
	16 A	-	-	-	300	500	700	1300	-	-	240	300	384	500	700	1300
	20 A	-	-	-	-	400	500	1000	-	-	-	300	384	480	600	1000
	25 A	-	-	-	-	-	500	800	-	-	-	-	384	480	600	800
	32 A	-	-	-	-	-	500	600	-	-	-	-	-	480	600	756

.T = Total discrimination

Selectivity with upstream Moulded Case Circuit Breakers (MCCBs) :

. Selectivity limit at 230/400 V~: values in Ampere.

Downstream RCBO		Upstream MCCB							
		DPX ³ 160 16 kA to 50 kA							
		16 A	25 A	40 A	63 A	80 A	100 A	125 A	160 A
DX ³ 6000 A C curve	10 A	5	T	T	T	T	T	T	T
	13 A	-	T	T	T	T	T	T	T
	16 A	-	T	T	T	T	T	T	T
	20 A	-	5	5	5	5	6	T	T
	25 A	-	-	4,5	4,5	4,5	4,5	T	T
	32 A	-	-	-	3	4	4	T	T

DX³ 4-pole RCBO 6000 A / 10 kA

Cat. N°(s) : 4 111 93, 4 111 94, 4 111 95, 4 112 12, 4 112 13, 4 112 14

5. GENERAL CHARACTERISTICS *(continued)*

Selectivity with upstream Moulded Case Circuit Breakers (MCCBs) :

. Selectivity limit at 230/400 V~: values in Ampere.

Downstream RCBO		Upstream MCCB		
		DPX ³ 250		
		40 A	100 A	160 à 250 A
DX ³ 6000 A C curve	10 A	T	T	T
	13 A	T	T	T
	16 A	T	T	T
	20 A	5	T	T
	25 A	4	T	T
	32 A	-	5	T

Downstream RCBO		Upstream MCCB
		DPX ³ 630 / 1600 DMX ³ 2500 / 4000
		160 à 4000 A
DX ³ 6000 A C curve	10 A	T
	13 A	T
	16 A	T
	20 A	T
	25 A	T
	32 A	T

Downstream RCBO		Upstream MCCB		
		DPX ³ 250 ER AB		DPX ³ 400 AB
		90A	130 to 240 A	320 and 400 A
DX ³ 6000 A C curve	10A	T	T	T
	13 A	T	T	T
	16 A	T	T	T
	20 A	T	T	T
	25 A	T	T	T
	32 A	5	T	T

. T = Total discrimination

5. GENERAL CHARACTERISTICS *(continued)*

Product weight :

Catalogue Number	Description	Weight (kg)
4 111 93	C10 6000A A 30MA	0,48
4 111 94	C13 6000A A 30MA	0,48
4 111 95	C16 6000A A 30MA	0,48
4 112 12	C20 6000A A 30MA	0,48
4 112 13	C25 6000A A 30MA	0,48
4 112 14	C32 6000A A 30MA	0,49

6. COMPLIANCE AND APPROVALS

In accordance with standards :

- . EN/IEC 61009-1 (NF C 61440)

Usage in special conditions :

- . Category C compliant (testing temperature range from -25°C to +70°C, resistant to salt spray) in accordance with the classification defined in Appendix Q of standard IEC/EN 60947-1

Respect for the environment – Compliance with European Union Directives :

- . Compliance with Directive 2002/95/EC of 27/01/03 known as "RoHS" which provides for a restriction on the use of dangerous substances such as lead, mercury, cadmium, hexavalent chromium and polybrominated biphenyl (PBB) and polybrominated diphenyl ether (PBDE) brominated flame retardants from 1st July 2006
- . Compliance with the Directive 91/338/EEC of 18/06/91 and decree 94-647 of 27/07/04

Plastic materials :

- . Halogen free plastic materials
- . Labelling of parts compliant with ISO 11469 and ISO 1043.

Packaging :


- . Design and manufacture of packaging compliant with decree 98-638 of 20/07/98 and Directive 94/62/EC

Approvals obtained :

- . France: NF

7. CURVES


Thermal-magnetic tripping curve range typical of C curve RCBOs :

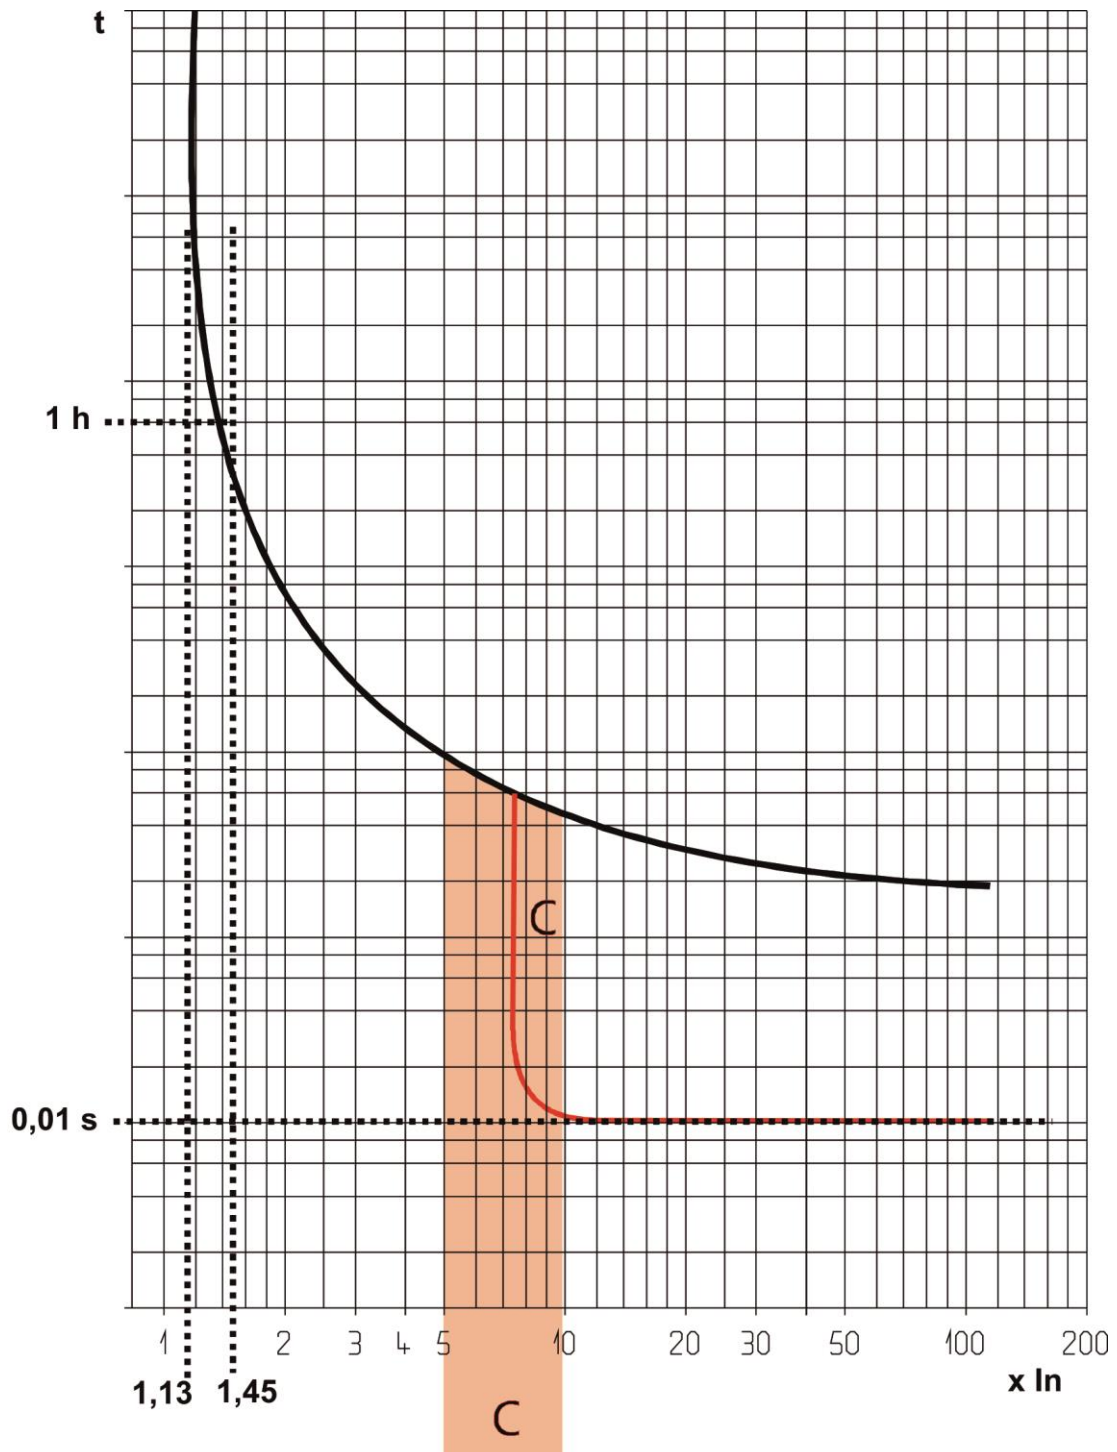

Thermal tripping at ambient temperature = 30°C
In = RCBO rated current

7. CURVES *(continued)*


Average thermal-magnetic tripping curves range typical of C curve circuit RCBOs :

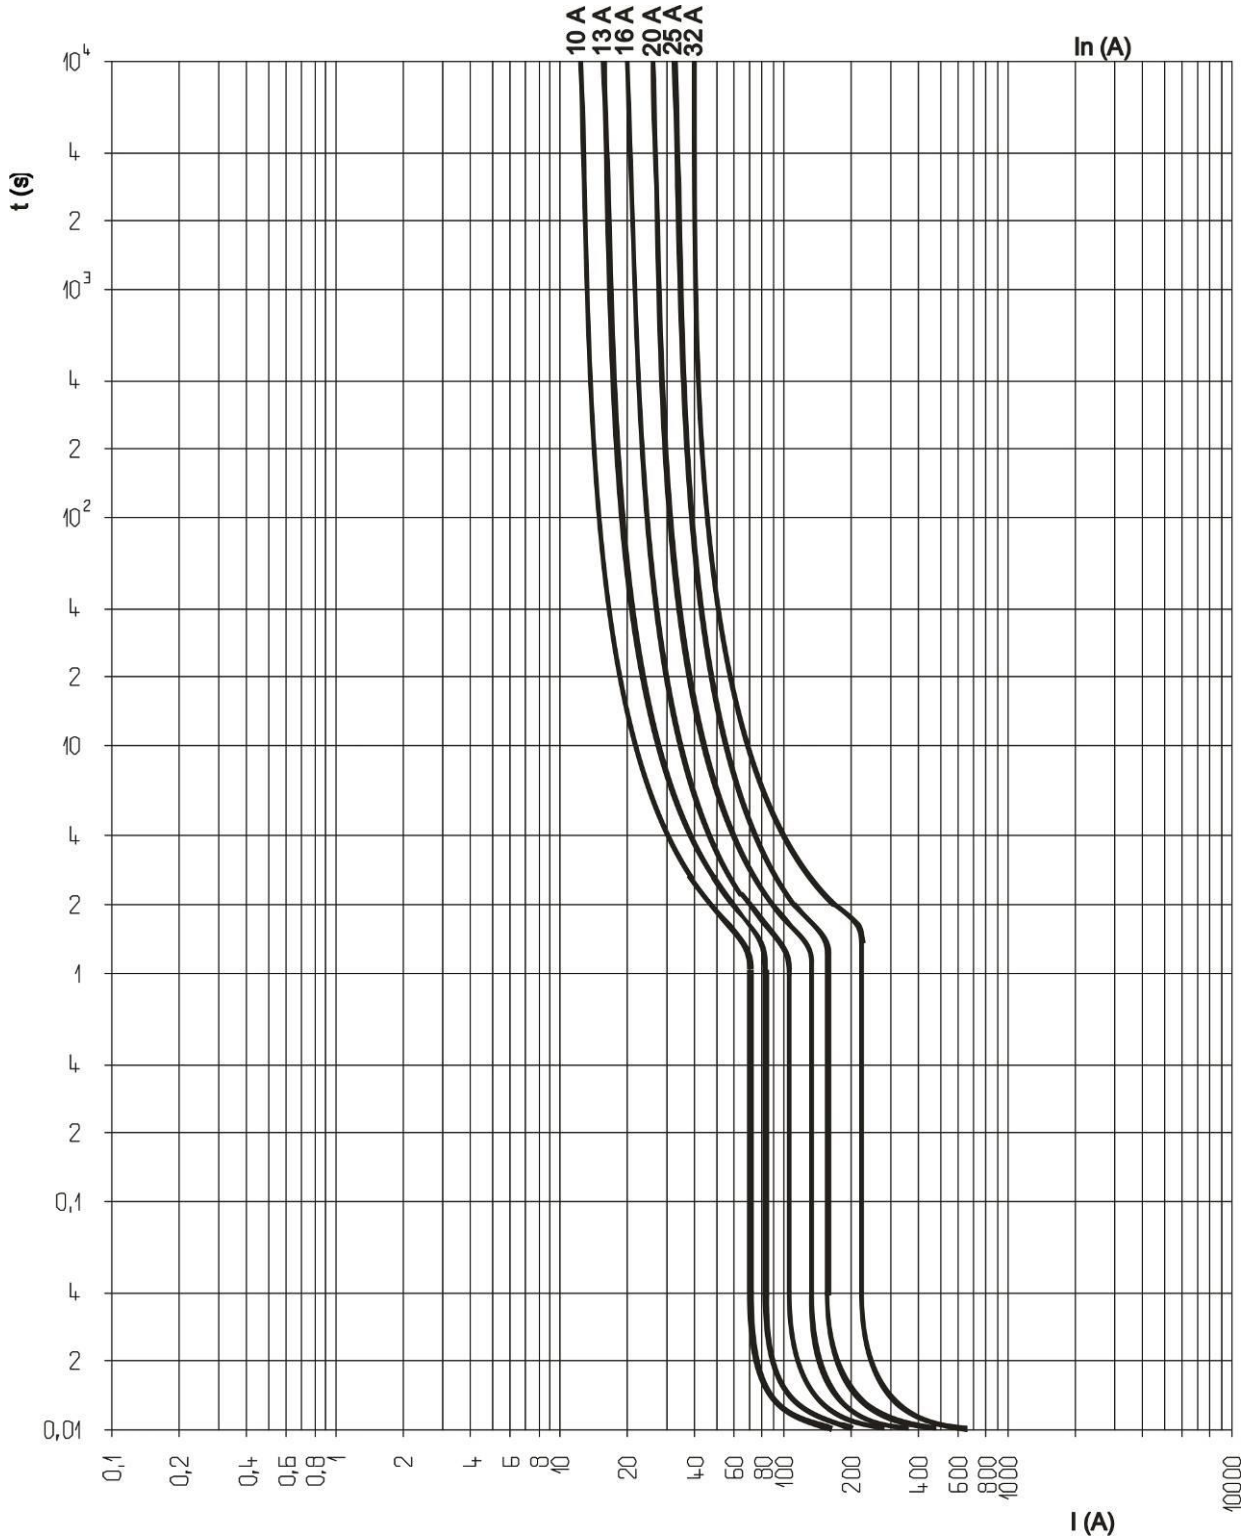

7. CURVES (continued)

Current limiting curves :

. C curve 4-pole RCBO

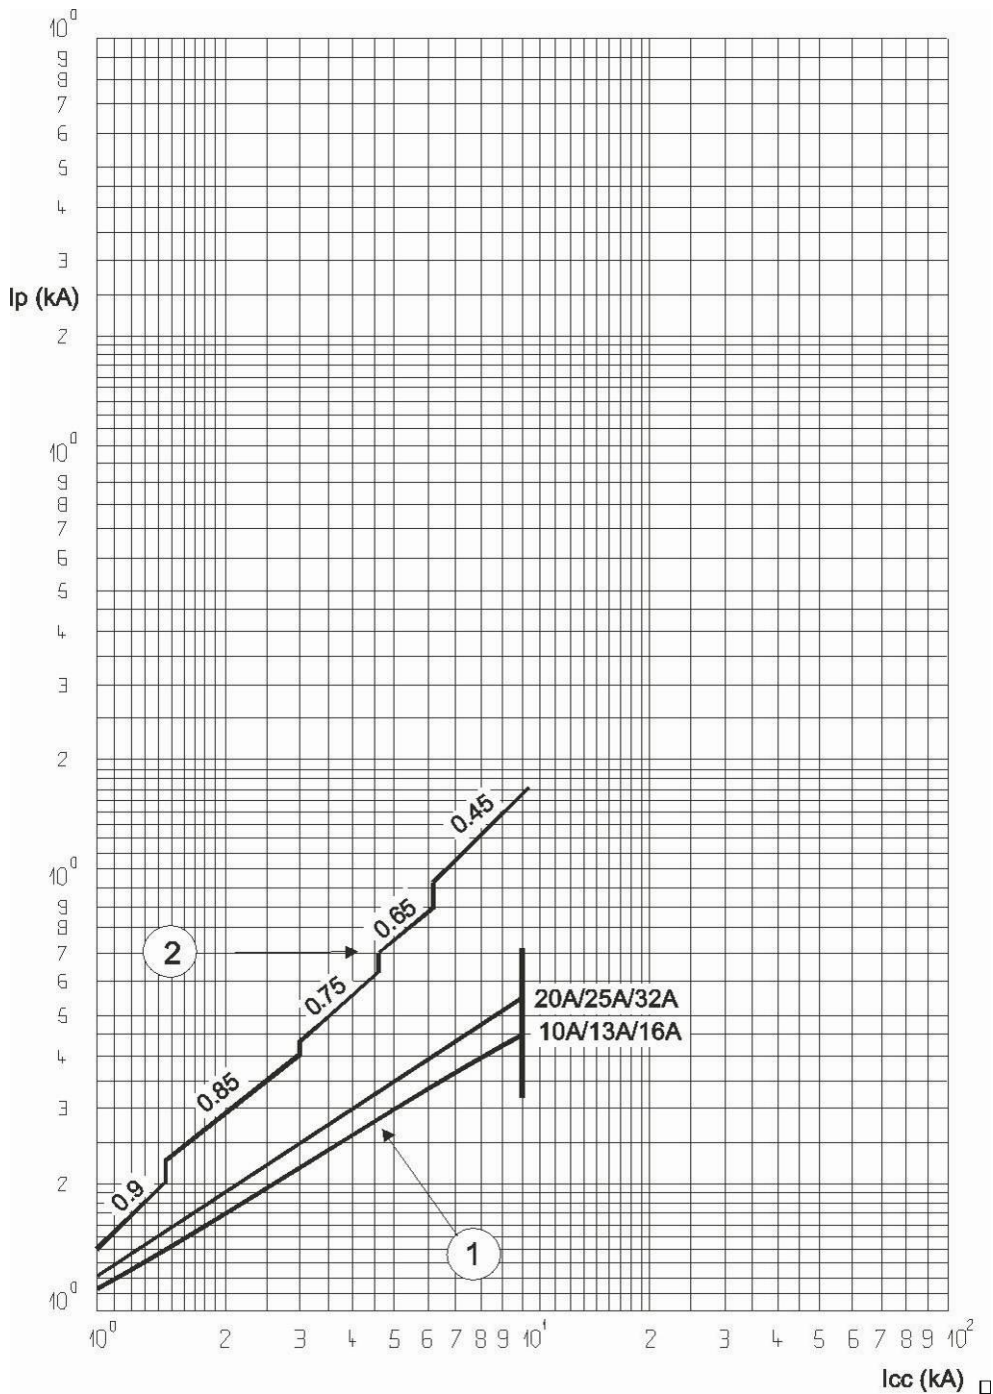

I_{cc} = Prospective short-circuit symmetrical current (rms value in kA)

I_p = Maximum peak value (kA)


① = Short-circuit rms currents (max. peak)

② = Unlimited peak currents (max), corresponding to power factors shown above (0.15 to 0.9)

7. CURVES *(continued)*

Thermal stress limiting curves :

. C curve 4-pole RCBO

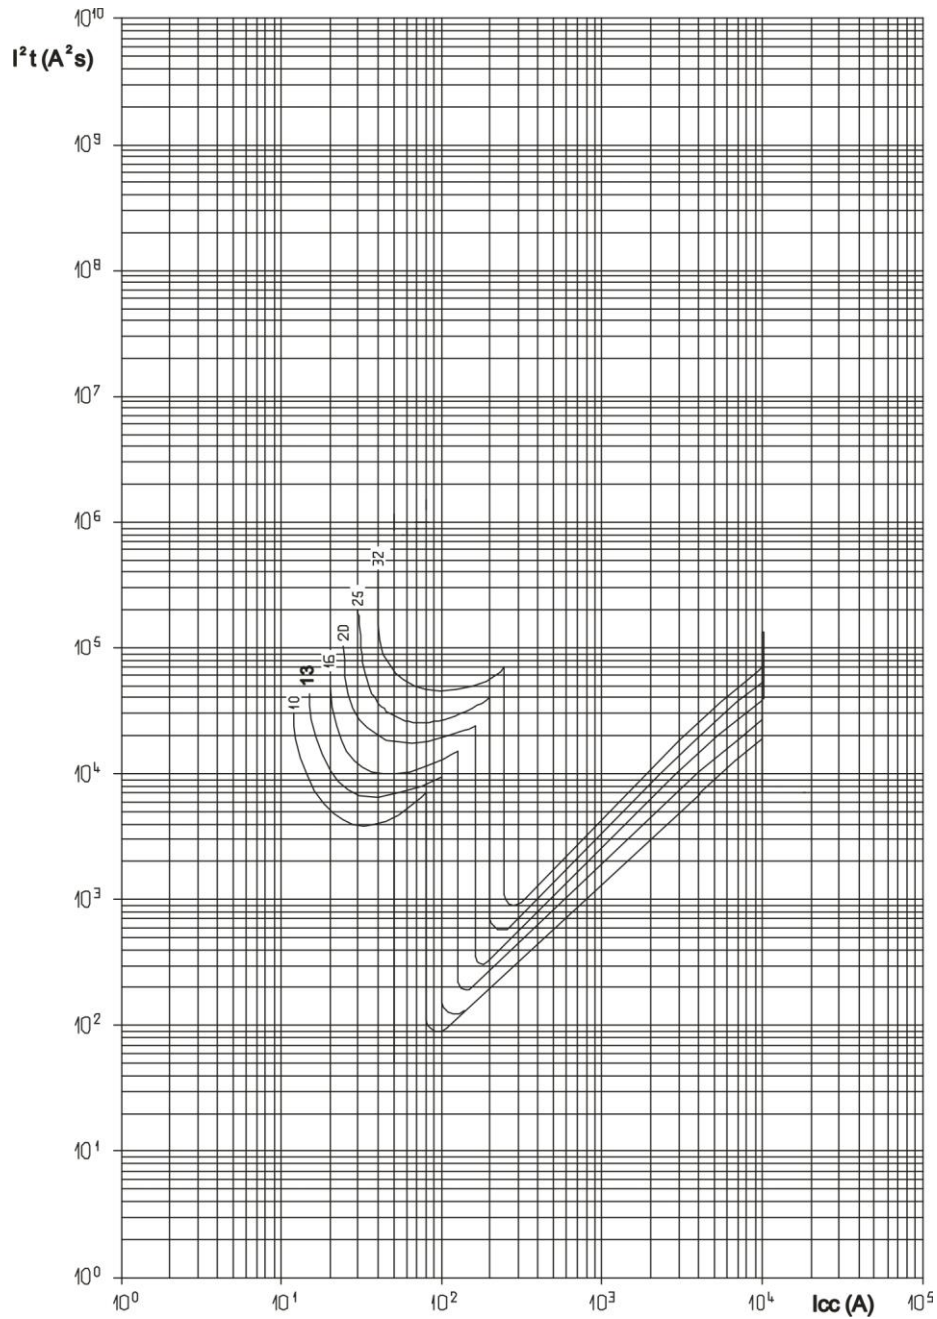


I_{cc} = Prospective short-circuit symmetrical current (rms value in kA)

I^2t = Limited thermal stress (in A^2s)

7. CURVES (continued)

Tripping current curves :

. Tripping time curve depending on the value of the fault current:

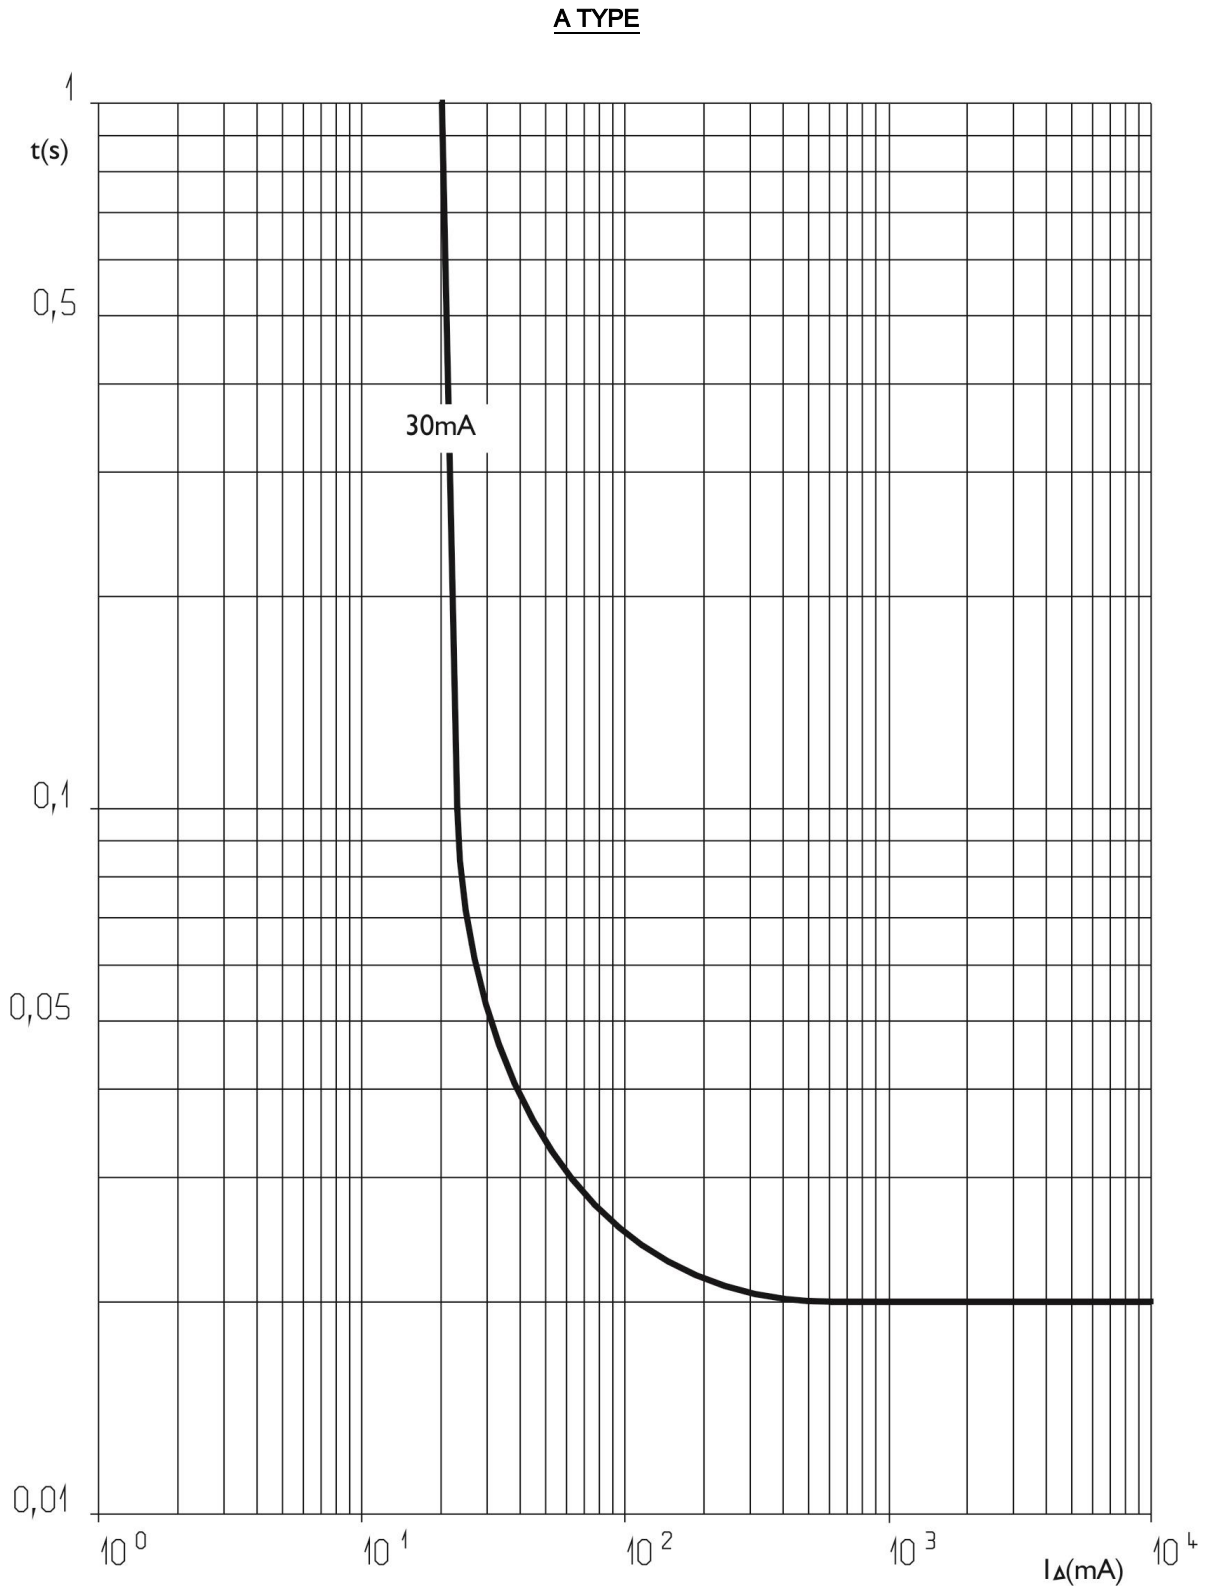

8. AUXILIARIES AND ACCESSORIES

Wiring accessories :

- . Supply busbar HX³ 4-pole (Cat. No. 4 052 00, 01, 02)
- . Sealable screw cover (Cat. No. 4 063 04)

Signalling auxiliaries :

- . Auxiliary contact (0.5 module, Cat. No. 4 062 58)
- . Fault signalling contact (0.5 module, Cat. No. 4 062 60)
- . Auxiliary contact that can be changed into fault signalling contact (0.5 module, Cat. No. 4 062 62)
- . Auxiliary contact + fault signalling contact that can be changed into 2 auxiliary contacts (1 module, Cat. No. 4 062 66)

Control auxiliaries :

- . Shunt trip (1 module, Cat. No. 4 062 76, 2 78)
- . Undervoltage release (1 module, Cat. No. 4 062 80, 82)
- . Stand-alone release for N/C push-button (1.5 module, Cat. No. 4 062 87)
- . Power Overvoltage Protection "pop"(1 module, Cat. No. 4 062 86)

Motor driven control modules :

- Motor-driven control module (1 module, Cat. No. 4 062 90, 91)
- . Motor-driven control module with integrated automatic reset (2 modules, Cat. Nos. 4 062 93, 95)

Possible combinations of auxiliaries and RCBOs :

- . The auxiliaries are installed to the left of the RCBOs
- . Maximum number of auxiliaries = 3
- . Maximum number of 1 module signalling auxiliaries = 2
- . Maximum number of control auxiliaries (Cat. Nos. 4 062 76 to 4 062 87) = 1
- . The control auxiliary trip (Cat. Nos. 4 062 76 to 4 062 87) must mandatorily be placed to the left of the signalling auxiliaries (Cat. Nos. 4 062 58 to 4 062 66) where the auxiliaries from these 2 families are connected to the same RCBO
- . Front external rotary handles (Cat. Nos. 4 063 19, 4 063 20)

Sealing :

- . Possible in the open or closed positions

Locking options :

- . Via padlock 5 mm in diameter (Cat. No. 4 063 13) or padlock 6 mm in diameter (Cat. No. 227 97) and padlock support (Cat. No. 4 063 03)

Installation software :

- . XL PRO³

9. SAFETY

- . For your safety your electrical installation is equipped with residual current protection and this must be tested periodically. In the absence of any national regulations on the time period required for this, Legrand recommends that this test be carried out every month: press the "T" test button, the device should trip. Please call an electrician immediately if this does not happen as the safety level of your installation has been reduced
- . The presence of residual current protection does not remove the need to observe all the precautions associated with using electrical energy